


Water Metering & Servicing Guidelines

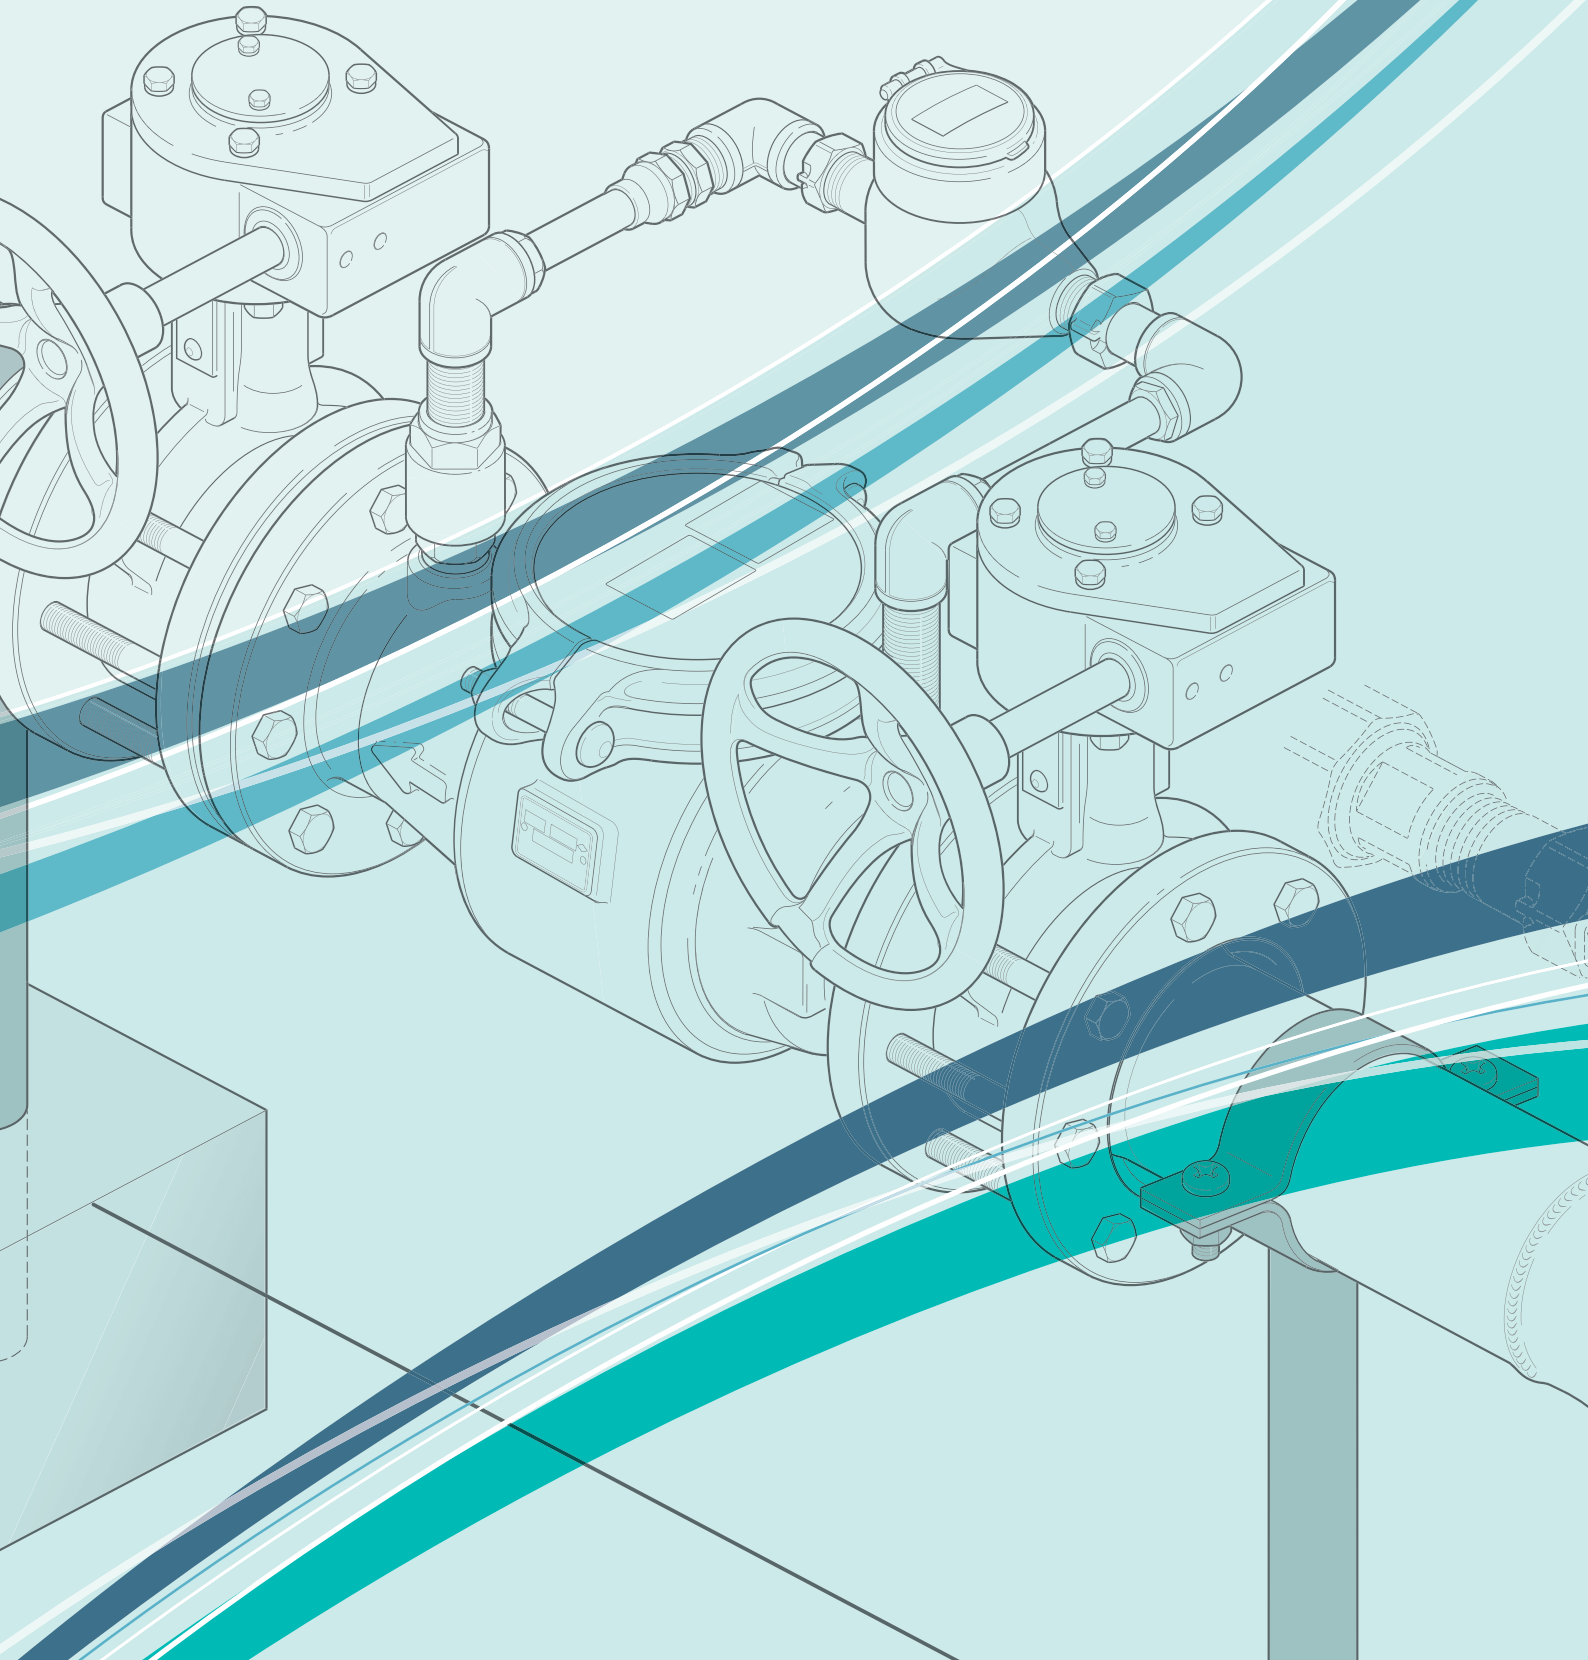

Water Metering & Servicing Guidelines

CONTENTS

Acronyms & Abbreviations

1	INTRODUCTION	1
2	PURPOSE	2
3	WATER SERVICE METERING	2
4	OUTLINE OF APPLICATION PROCESS AND PAYMENT OF FEES	2
5	DEFINITIONS & ABBREVIATIONS	3
5.1	Definitions	3
5.2	Relevant Standards.....	5
6	WATER METER POSITIONING	6
6.1	Positioning of Main Water Meters	6
6.2	Positioning of Sub/Check Meters	8
6.3	Offsetting of Existing Main Water Meters	10
6.4	Water Meter Pits	10
6.5	Protection of Water Meters	12
7	WATER MAIN CONNECTIONS (TAPPINGS).....	13
7.1	Wet Tappings	13
7.2	Dry Tappings for Drinking Water Supply (Residential Only).....	14
7.3	Dry Tappings for Class A Recycled Water (where available)	15
7.4	Tapping Excavations	16
7.5	Plug and Re-Tap at the Water Main	18
7.6	Re-Use of Existing Tappings	18
7.7	Upsizing and Downsizing of Existing Services.....	19
7.8	Sizing of Water Meters and Property Service Pipes	19
7.9	Selection of Water Meters.....	19
8	OTHER RELATED GUIDELINES.....	20
8.1	Backflow Prevention.....	20
8.2	Remote Water Meters	20
8.3	Material for Main to Water Meter Property Service Pipes 20mm to 50mm	20
8.4	Material for Main to Water Meter Service Pipes 80mm and Larger	21
8.5	Water Meter Ownership	21
8.6	Damaged, Missing and Stolen Water Meters.....	21
8.7	Removal of Water Meters	21
8.8	Return of Water Meters	21
8.9	Use of a Data Logger	22
8.10	Service Pipes	22
8.11	Pressure Limiting Valve.....	22
8.12	Hot Water Meters	22
8.13	Inline Pumping	22
8.14	Inline Boosting.....	22
9	RESPONSIBILITIES	23
9.1	Property Service Pipes up to and Including 50mm	23
9.2	Property Service Pipes over 50mm.....	23
9.3	Internal Pipe Work.....	23
9.4	Remote Water Meters	23
9.5	All Other Services	23
10	GENERAL WATER AND FIRE SERVICE VALVING ARRANGEMENTS	24
10.1	Grouped Water Meters	24
10.2	Non-Compliant Installations	24
10.3	Fire Services	25
10.4	Fire Service Pumping.....	26

11	RESIDENTIAL WATER METERING AND SERVICING	27
11.1	Single Dwelling Residential Development.....	27
11.2	New Dual Dwelling Residential Development.....	28
11.3	Multi-Dwelling Residential Development (Greater than two units and less than 20 units ground floor/ground and first floor)	32
11.4	Multi-Dwelling Residential Development (Greater than 19 units ground floor/ground and first floor).....	33
11.5	Multi-Dwelling Residential Development (High Rise multi dwelling, greater than two floors)	33
11.6	Dependent Living Residential Units ('Granny Flat').....	34
11.7	Moveable Residential Units (DoH 'Granny Flats')	34
11.8	Residential Caravan Parks.....	35
12	NON-RESIDENTIAL WATER METERING AND SERVICING	36
12.1	Single Occupancy Non-Residential Development	36
12.2	Multi-Occupancy Non-Residential Development.....	38
13	WATER METERING IN SPECIAL CASES.....	40
13.1	Mixed Developments.....	40
13.2	Additional Units or Factoryettes to Existing Developments.....	42
13.3	Existing Multi-Occupancy Residential and Non-Residential Developments with no existing Sub/Check Meters	43
13.4	Properties Serviced by Temporary Private Water Service	44
13.5	Bulk Water/Common Water.....	46
13.6	Trade Waste	46
13.7	Non-Residential Irrigation Systems/Council Open Space.....	47
13.8	Water Connections for properties having Drinking Water/Class A recycled water (other than single residential dry tapped properties).....	49
14	DRAWINGS.....	56

FIGURES

Figure 6.1:	Drinking Water Only	6
Figure 6.2:	20mm Class A Recycled Water & Drinking Water. Water Meter Assemblies Installed by Water Business	7
Figure 6.3:	Drinking Water & Class A Recycled Water.....	7
Figure 6.4:	Individual Occupancy Sub/Check Meter	8
Figure 6.5:	Meter Cupboard Located in Common Access Area	9
Figure 6.6:	High Rise Sub/Check Meter Typical Arrangement.....	9
Figure 6.7:	Offsetting of Existing Water Meters.....	11
Figure 7.1:	Drinking Water Wet Tapping.....	13
Figure 7.2:	Drinking Water Dry Tapping	14
Figure 7.3:	Class A Recycled Water.....	15
Figure 7.4:	Minimum Size of Excavation for Water Trappings and Pluggings.....	17
Figure 10.1:	Typical Tapping Under Pressure Greater than 50mm.....	24
Figure 10.2:	Typical Boosted Fire Service with Single Check Detector Valve	26
Figure 11.1:	Drinking Water & Class A Recycled Water.....	27
Figure 11.2:	Typical Dual Occupancy Residential Development	28
Figure 11.3:	Typical Dual Occupancy Where Only One Dwelling has Water Main Frontage.....	29
Figure 11.4:	Existing Dual Occupancy Developments with a main meter only	31
Figure 11.5:	Typical Multi-Dwelling Residential Development	32
Figure 11.6:	Dependent Persons Residential Units	35
Figure 12.1:	Single Occupancy Non-Residential Development	37
Figure 12.2:	Multiple Occupancy/Non-Residential Development.....	39
Figure 13.1:	Typical Mixed Development	41
Figure 13.2:	Additional Units or Factories to Existing Developments where Existing Unit Owners Do Not Wish to be Individually Metered	42
Figure 13.3:	Private Water Main Remote from Reticulation Supply	44

Acronyms & Abbreviations

AS	Australian Standard
GWIP	Galvanised Wrought Iron Pipe
RW	Recycled Water (Class A)
DoH	Department of Health, formally the Department of Human Services
Ø	Nominal Internal Pipe Diameter
DPU	Dependent Persons Unit
EPA Victoria	Environment Protection Authority Victoria

1 INTRODUCTION

These Water Metering Guidelines have been introduced to provide consistency across the three Metropolitan Melbourne Water Businesses.

The guidelines will benefit the plumbing, building and developer industries, including plumbers, designers, builders, developers, property owners, plumbing specialists and Water Business staff.

The guidelines have been prepared as a combined effort by the three Water Businesses - City West Water, South East Water and Yarra Valley Water.

2 PURPOSE

These guidelines document the necessary water metering and water servicing conditions required by the Water Businesses for new developments, alterations to existing developments and existing water metering arrangements. These guidelines are not a technical document and should be used as a guide and for illustrative purposes only. For more detailed technical information refer to [AS/NZS3500 pt 1 2003](#) National Plumbing and Drainage Code and Water Services Association of Australia (WSAA). Wherever possible, conditions have been standardised to assist the industry/customer. The water metering guidelines refer to standard development projects and apply to the majority of development proposals. Where these policies are inappropriate for a particular development, the Relevant Water Business will determine the necessary requirements on a case-by-case basis.

These guidelines are to be read in conjunction with the Water Business' 'Conditions of Consent' under Section 63 of the Water Industry Act 1994.

3 WATER SERVICE METERING

All Water Businesses require the installation of an approved water meter (known as the main water meter) to measure the volume of water supplied through each property service pipe to a parcel of land.

In addition to this, additional water meters (known as sub or check meters) are required to measure the volume of water supplied to certain types of “dwellings/occupancies” located within that parcel of land as well as possibly measuring water for certain purposes within a property i.e. water used for irrigation.

Water meters, at a cost, will be provided by Water Businesses and the water meter technology will be appropriate to the type of development, intended purpose and required flow rates. The Water Businesses will endeavour to provide the most cost effective water meter, however some water services (like fire services) will require a different water meter arrangement which will not impede water flow or introduce pressure losses. These water metering arrangements may be at a higher cost.

Note:

- All water meters must be a type approved by the Water Business for the purpose of billing and be fit for purpose.
- Only water meters approved for horizontal installation shall be installed horizontally and must have a register at or near vertical to the horizontal axis of the water meter.

4 OUTLINE OF APPLICATION PROCESS AND PAYMENT OF FEES

Refer to the individual Water Business' application requirements.

5 DEFINITIONS & ABBREVIATIONS

5.1 Definitions

Self Contained Occupancy Commercial/Industrial	Has the same meaning as used by Council Valuers for producing valuations to determine municipal rates. The definition of the term has been developed by both Common law and legislation, in accordance with the Valuation of Land Act 1960 and Local Government Act 1989. For the purpose of determining the appropriateness of water metering/provisioning for metering, a self contained occupancy shall contain a tea sink, toilet and basin as a minimum. The occupants are not required to utilise common facilities outside the individual occupancy. All parent property general water connections are required to be metered in accordance with the requirements documented in these guidelines.
Main Water Meter	A main water meter is the Water Business' approved water meter connected directly from the water main located as close as possible to the properties' title boundary.
Dwelling (Residential)	A dwelling is a self-contained building erected on the land of the property owner and is used or intended to be used as a separate residence. A dwelling must contain a minimum of kitchen, bathroom and sanitary facilities to be considered self-contained. <i>Source: Based on the definition of 'dwelling' in Section 46H of the Planning and Environment Act (Vic) 1987.</i>
Backflow	Backflow is the reverse flow of a liquid within a piped plumbing system. It may be caused from back siphonage, back-pressure or a combination of both. It can result in contaminants being drawn back into the Water Business' water supply system through a cross connection. All general water connections to the water supply system must provide for an appropriate containment backflow prevention device at the outlet of the main water meter, in accordance with the relevant Australian Standard.
Dry Tapping	A dry tapping is generally 20mm in diameter (nominal Ø) and installed by the developer at the time the water mains are laid within residential estates. A dry tapping includes a connection and service pipe which terminates within each parcel of land (lot) within the estate. The Water Business installs the water meter assembly including the water meter on request and payment of the applicable fee.
Wet Tapping	A wet tapping is a type of connection which is made into the reticulated water supply main under pressure. A wet tapping may be for any size from 20mm Ø to 200mm Ø and greater. <i>Please note: The service pipe work and water meter assembly must be in place prior to the connection being made.</i>
Remote Reading Water Meter	A remote water meter may consist of a conventional water meter with a remote reading device attached or an integrated unit. A remote reading device electronically records the volume of water flowing through the water meter and transmits the reading by radio or similar technology when activated by the water meter reader. The benefits of remote water meters are that the Water Business reads the water meter outside of the property thereby ensuring security and privacy for the customer.
Tapper	A Water Business representative authorised to carry out water tapping activities.

Tapping	Is the activity carried out to connect a new service to the water main.
Tee Insertion	Is similar to a wet tapping, however a tee insertion applies to a connection greater than 50mm Ø diameter where a tapping cannot be achieved under pressure. The plumber is responsible to excavate to expose the water main. The main is required to be shut off and therefore existing customers connected to the main must be notified prior to the work taking place. The Relevant Water Business representative will cut a section of main out and insert the tee piece or in some cases plug and seal the service. Tee removals done in conjunction with new wet tapplings are to be carried out on the same day.
Potable Water	The highest quality water otherwise referred to as drinking water.
Recycled Water (Class A)	<p>Class A recycled water is the highest quality of recycled water and is achieved after a tertiary treatment process combined with pathogen removal.</p> <p>The DoH (www.health.vic.gov.au) has classified Class A recycled water as safe for use on irrigation for food crops – including those eaten raw. DoH requires an extensive verification process to ensure Class A water can be guaranteed. Environment Protection Authority Victoria (EPA Victoria) (www.epa.vic.gov.au) also supports its use.</p> <p>Class A recycled water has the widest range of uses including:</p> <ul style="list-style-type: none"> • Residential garden watering • Closed system toilet flushing • Process/cooling water for industry • Fire protection reticulation systems (external to the property) • Irrigation of municipal parks and sports grounds • Water for contained wetlands or ornamental ponds • Food crops that are consumed raw or sold to consumers uncooked or processed • All of the uses listed for classes B - D.
Plug Off/ Plugging	Is when an existing tapping up to and including 50mm Ø is required to be removed. The plumber is responsible to excavate to expose the tapping and a Water Business representative will seal the service. Plug offs done in conjunction with new wet tapplings are to be carried out on the same day.
Tee Removal	Is when an existing connection greater than 50mm Ø is required to be removed. The plumber is responsible to excavate to expose the tee/tapping band. The main may be required to be shut off and therefore existing customers connected to the main must be notified prior to the work taking place. The Relevant Water Business representative will cut the tee piece out or in some cases seal the service. Tee removals done in conjunction with new wet tapplings are to be carried out on the same day.
Single Check Detector Valve	<p>A single check detector valve is designed to prevent the unwanted reversal of flow from the fire service into the Water Business' water supply system. It also provides both customer and the Water Business details of water usage through a fire service. Low volumes are recorded on a 'by-pass water meter' which is read on a regular basis. Benefits include:</p> <ul style="list-style-type: none"> • Identification of unaccounted water use • Assists in the proactive management of the water supply system.

Sub Meter/ Check Meter	An approved water meter connected after a main water meter is used to register water used by multi-dwelling/occupancy developments on a parcel of land. For billing reasons a sub/check meter must not be supplied through another sub/check meter; it must be supplied directly from a main water meter.
Property Service Pipe	A water pipe that supplies water from the reticulation main to the customer. The portion of the service pipe under the control of a Water Business generally terminates at the outlet of the water meter. Location on mains described as 'short side', meaning water mains on the same side of a road reserve as the parcel of land to be serviced, or 'long side' where the property service pipe is required to cross under a road way to reach the property.
Water Businesses	Refers to the three Melbourne Metropolitan Water Businesses licensed to provide drinking water, sewerage services and recycled water to properties in Urban Melbourne. The Water Businesses comprise of City West Water, Yarra Valley Water and South East Water.
Temporary Private Water Service	A temporary private water service is permitted in cases where the Water Business determines that a property is too remote from the existing reticulated water infrastructure, and is assessed having regard to potential future development. The water service is installed by the owner's/applicant's contractor external to the individual properties it services and is maintained and owned by the responsible legal entity. If/when reticulated water supply becomes available (water mains fronting the property) it is the responsibility of the individual property owner to transfer supply to the reticulated water main at the owners' expense. Where these services are not adequately maintained the respective Water Business may terminate supply having given property owners (legal entity) the appropriate notice.
Conditions of Connection	A list of conditions that the Relevant Water Business issues as part of its consent to carry out plumbing work for water and sewerage works. Provided for under section 63 of the <i>Water Industry Act 1994</i> .
Reticulated water/sewer supply system	A network of water/sewer mains, pump stations etc. owned and operated by the respective Water Business to provide for the community's water and sewerage needs.

5.2 Relevant Standards

- Plumbing Code of Australia
- Plumbing Regulations 2008 or subsequent versions
- Customer Charter
- AS/NZS 3500.1 Plumbing and Drainage – Water Services
- AS 3565 Meters for Water Supply
- *National Measurement Act 1960*
- National Measurements Regulations 1999
- Recycled Water Plumbing Guidelines
- AS 1851: 2005 Maintenance of Fire Protection Systems and Equipment
- Residential/Home Fire Sprinkler Services designed under the AS2118.4 or AS2118.5

6 WATER METER POSITIONING

6.1 Positioning of Main Water Meters

- The water meter assembly must be within two metres of the title boundary that abutts the water main.
- The water meter assembly must be fitted at right angles to the water main, in line with the tapping.
- The water meter assembly must be fully supported with minimum ground clearance of 150mm, and should not be greater than 300mm from the finished ground level to the base of the water meter assembly (where the Backflow prevention device is a Reduced Pressure Zone type, a minimum 300mm to the device vent is required).
- The water meter assembly must not be encased in concrete surrounds.
- Water meters must be readily accessible for reading, maintenance and replacement.
- Water meters can be installed in utility rooms or meter cabinets located within a common access area and be readily accessible, subject to the Water Business' approval.
- Recycled water meters are to be positioned to the left of the drinking water meter assembly.

Figure 6.1: Drinking Water Only

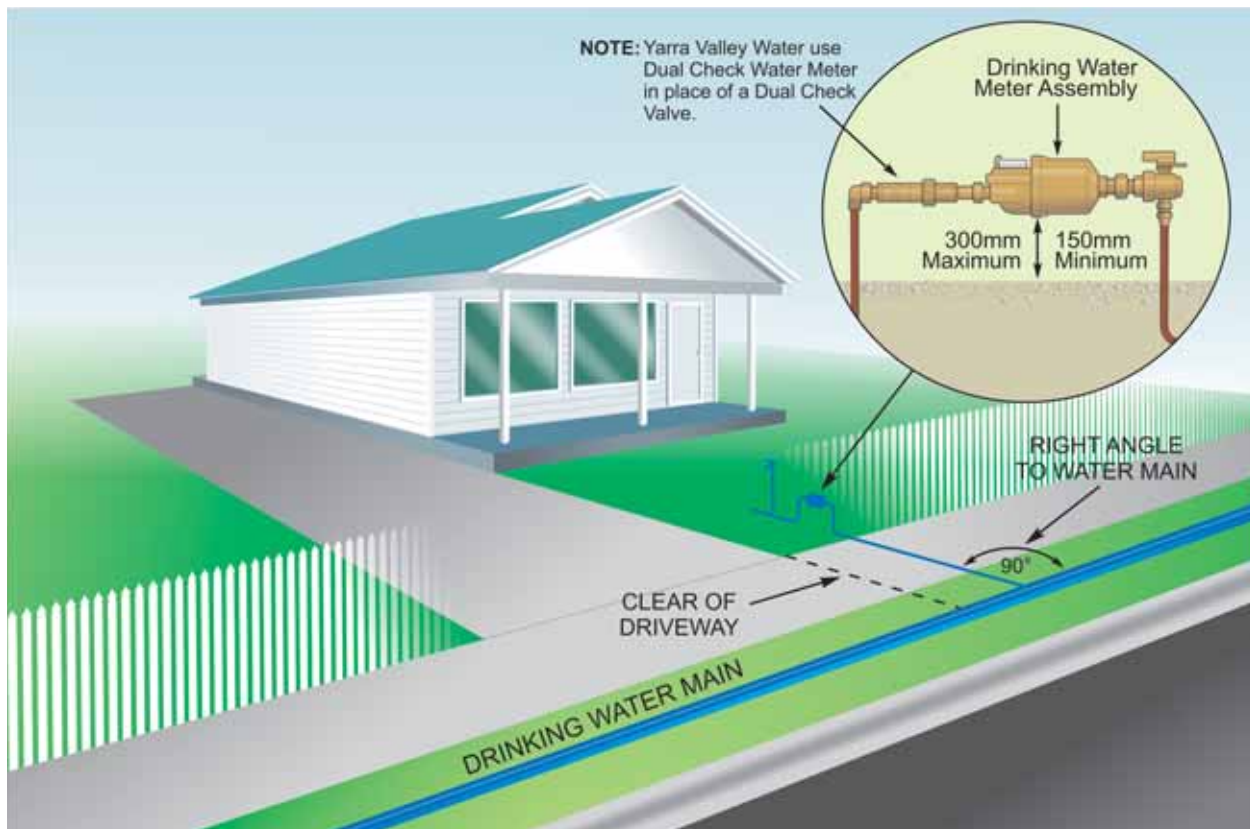


Figure 6.2: 20mm Class A Recycled Water & Drinking Water. Water Meter Assemblies Installed by Water Business


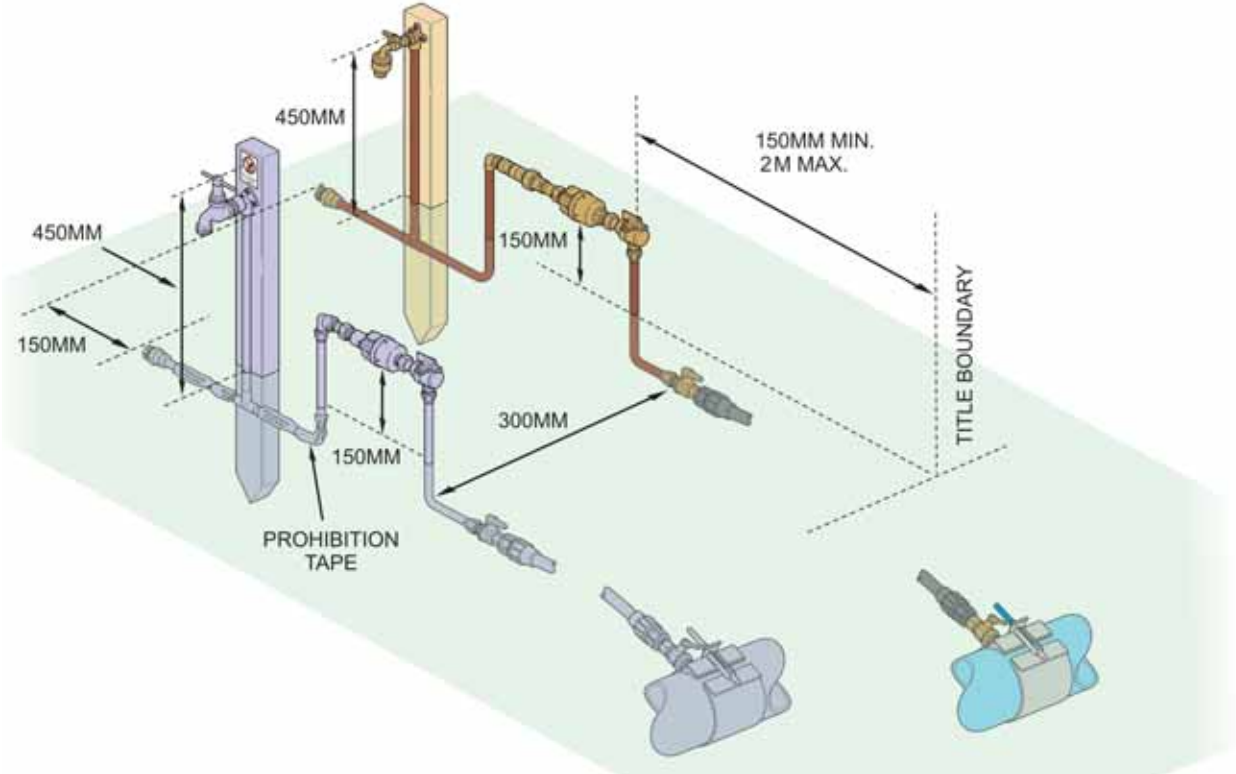


Figure 6.3: Drinking Water & Class A Recycled Water

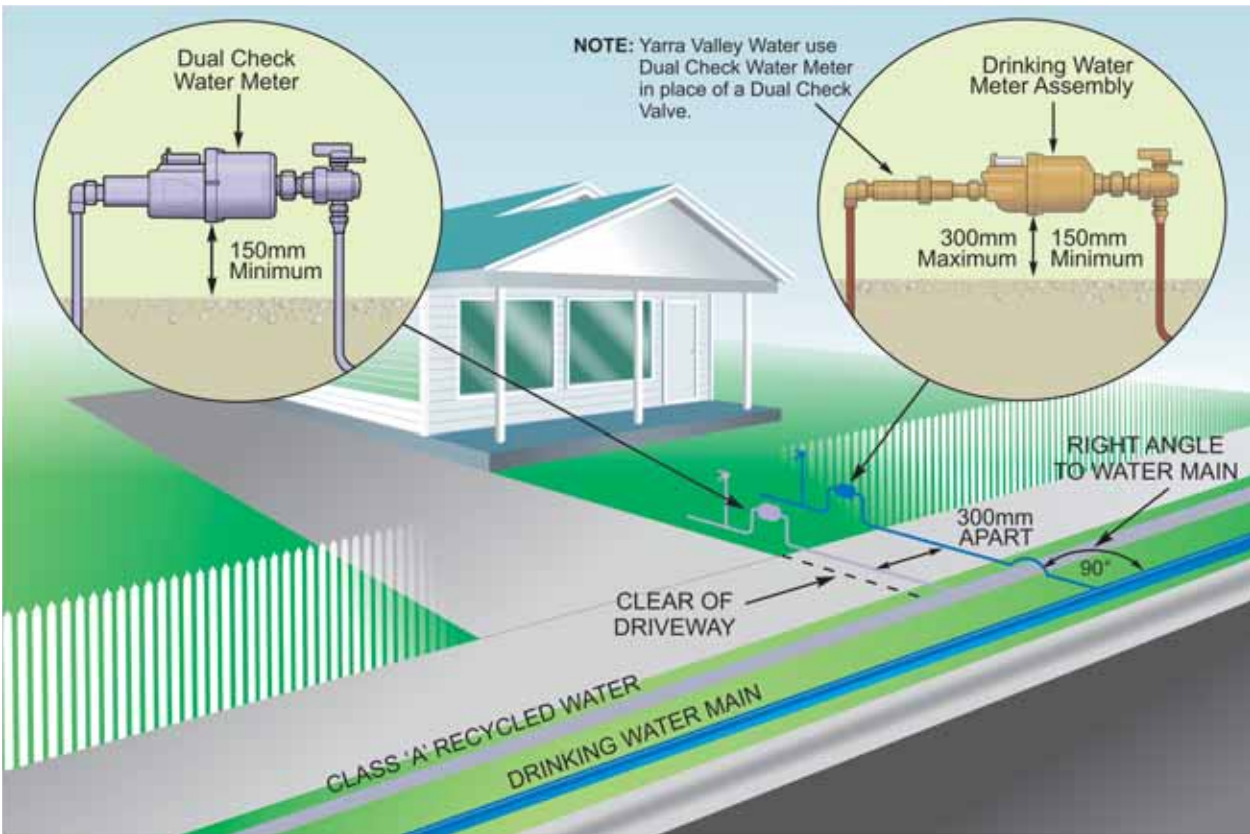

6.2 Positioning of Sub/Check Meters

- The unit number must be indicated or tagged on the service pipe near the water meter bracket.
- Remote water meters can be installed inside secured areas of main buildings provided that the following conditions are met:
 - Water meters are installed in utility rooms or meter cabinets located within common access areas on each level
 - Water meters are readily accessible for maintenance and replacement.
- Water meters must **not** be located:
 - Inside the units/apartments
 - Within the ceiling cavities of common access areas or pits.
- Provision for the water meters must be:
 - No less than 150mm above the finished floor level
 - No greater than 1.5m above the finished floor level (unless otherwise approved by the Relevant Water Business in writing)
 - With a minimum clearance above the centre of each pipe of 250mm
 - With a minimum clearance of 150mm between the centre of each pipe and any wall or door
 - The licensed plumber is to provide a water meter assembly including a temporary non metallic water meter spacer for each water meter, prior to the water meter installation.
- Separate isolating valves adjacent to each water meter installation in accordance with AS/ NZS3500 must be provided.

Note:

- An additional isolating valve is required on the outlet side of water meters where removal of the water meter may result in water damage to the building or excessive water wastage.
- Where water meter assemblies **only** are to be installed, the water meter spacer pipe is to be of an approved material type in accordance with the Plumbing Regulations incorporating the Plumbing Code of Australia. All other water metering requirements are to be complied with.

Figure 6.4: Individual Occupancy Sub/ Check Meter



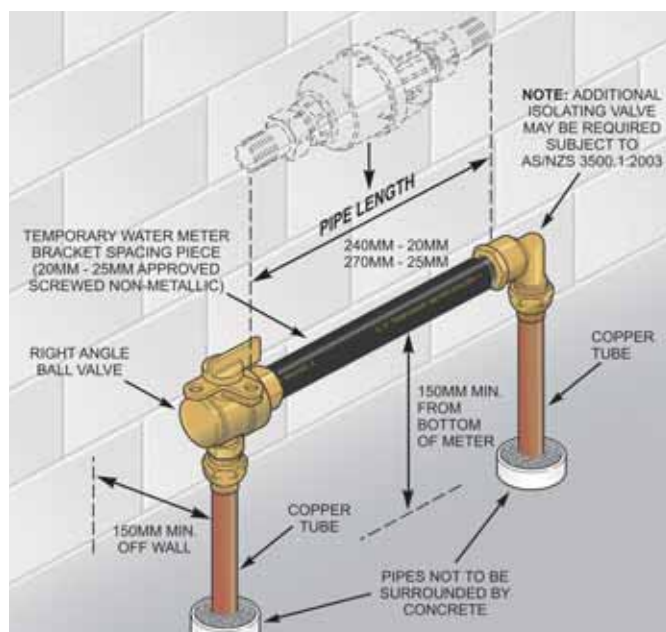


Figure 6.5: Meter Cupboard Located in Common Access Area

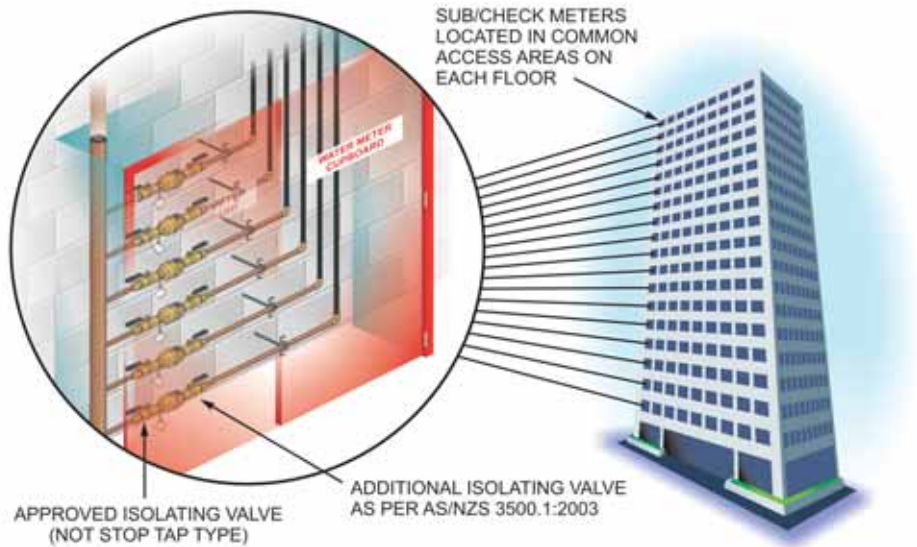

For detailed information refer to Figure 6.6

Figure 6.6: High Rise Sub/Check Meter Typical Arrangement

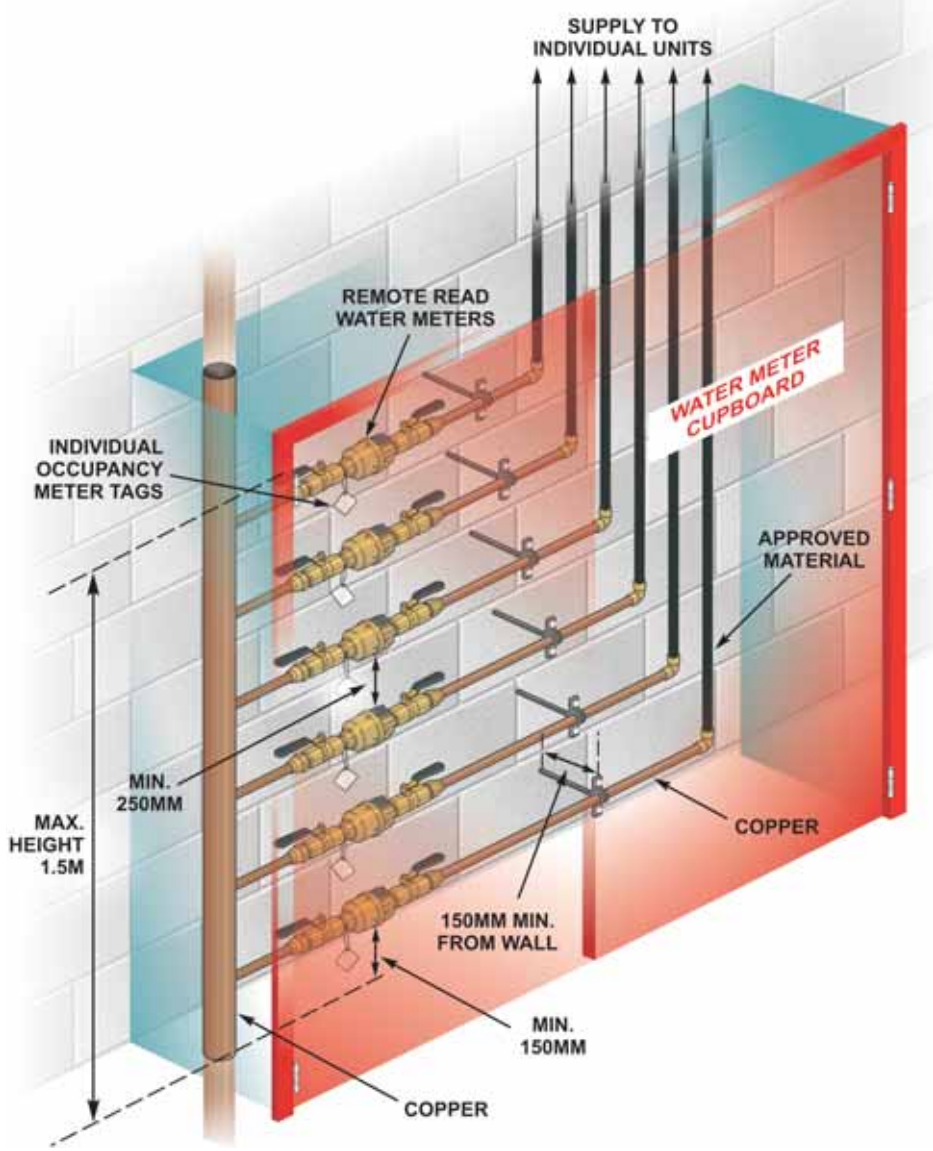

6.3 Offsetting of Existing Main Water Meters

Offsets in property services will not be permitted in new developments or redevelopments.

- Only permitted for additions/changes to existing site conditions, such as driveways, paving or fencing etc.
- All costs associated with the offsetting of existing water meters to be borne by the owner/ applicant.
- Existing water meter assemblies are permitted to be relocated where a proposed driveway/ fence will result in the assembly being a hazard or obstruction.
- The relocation of the assembly is permitted by either offsetting of the service pipe, or plugging and re-tapping the water main in accordance with the following guidelines:
 - The water meter may be offset a maximum of 600mm without the use of directional isolating valves.
 - A maximum offset of three metres is permitted with the use of directional isolation valves
 - The water meter assemblies must be located within two metres of the title boundary that abutts the water main.
 - If an existing water meter is removed from the assembly it is necessary to replace it with a new Water Business' water meter at the owners' expense.
 - Main to water meter work is to be carried out by owner's licensed plumber in accordance with clause 6.1, at owners' expense.
- These guidelines apply equally for tappings located on the same side (short) of the road reserve and those located on the opposite side (long) of the road reserve.
- Where the relocation of any Class A recycled water meter assembly is required, it is to be carried out by the Relevant Water Business. Both assemblies (drinking water and Class A) will be relocated at the owners' expense. The assemblies shall remain 300mm apart with the drinking water meter assembly located on the right hand side.

6.4 Water Meter Pits

Where conditions in Section 6 'Positioning of Water Meters' cannot be met, main and/or sub/check meters may be permitted to be installed in a pit, however it must be demonstrated that all listed options to install the water meter above ground have been adequately explored to the satisfaction of the Relevant Water Business. In such cases, the pit must conform to the following requirements:


- Be constructed in an impervious material and be of a standard adequate to the location it is to be installed.
- Have a lid which can be safely and easily removed by one person.
- In trafficable areas must provide for a cover adequate to the loads experienced as well as access for reading (i.e. trap door).
- Provide adequate space around the water meter (within the pit) for maintenance and replacement.
- Where a testable (double check valve) backflow prevention device is installed, the pit provides for ease of maintenance of the device and assembly components.**

- Be drained to prevent the pit retaining water (i.e. connected to the storm water system).
- The owner of the pit is responsible to maintain the pit in good order, conforming to the above requirements at all time and is responsible for any costs applicable.
- A pit located outside the title boundary and/or on council property requires the property owner to gain appropriate approval prior to the installation of the pit.

Note:

- Aesthetics is not considered a valid reason to locate a water meter in a pit.
- Reduce Pressure Zone devices must not be installed in pits.

Figure 6.7: Offsetting of Existing Water Meters

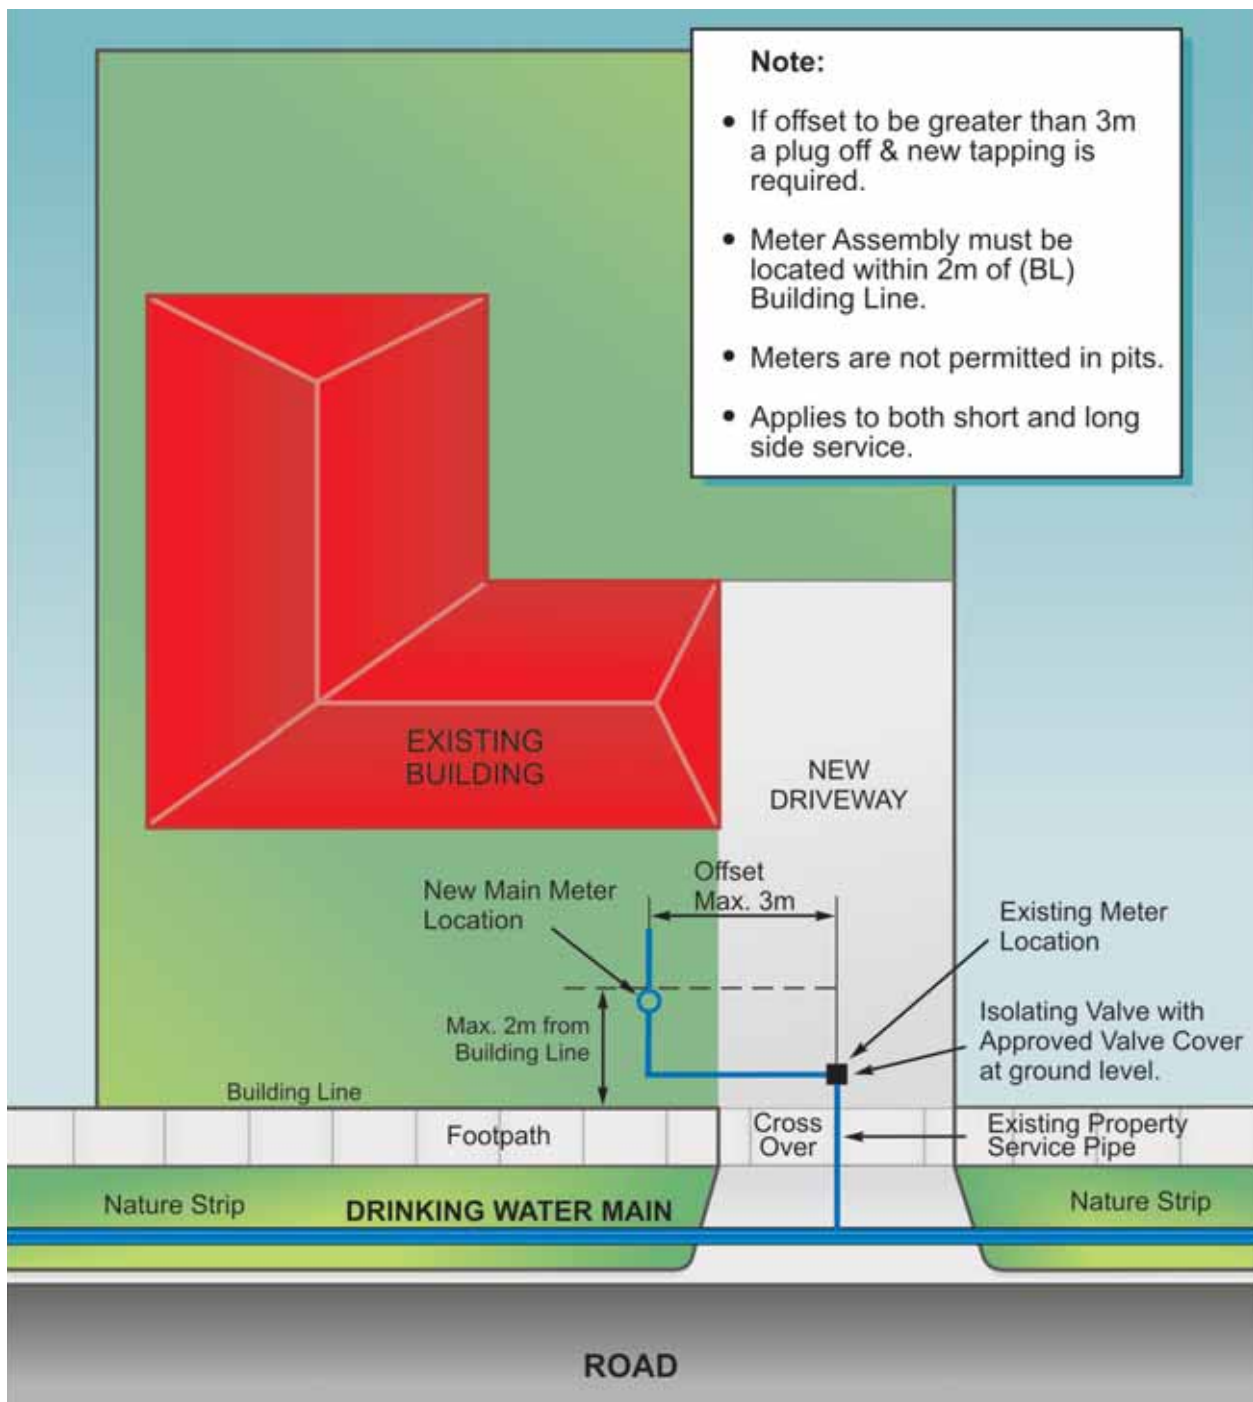

6.5 Protection of Water Meters

In order to provide protection for water meters, the Water Business may require the installation of a water meter cage to be installed.

In such cases the cages must conform to the following requirements:

- Must have a gate which can be safely and easily opened by one person. If lockable, a standard industry key or 003 key must be able to open the lock.
- Provide adequate space around the water meter (within the cage) for maintenance and or substitution of the water meter.
- The property owner is the owner of the cage and is responsible for the maintenance and safekeeping of the cage.
- Cages located on council property require the property owner to gain appropriate council approval prior to the installation of the cage/s.
- Safety bollards may be applicable in some cases.

7 WATER MAIN CONNECTIONS (TAPPINGS)


7.1 Wet Tappings

The responsible Water Business representative performs the tapping. Plumbers are not permitted to carry out this work.

Not all water mains/aquaducts are capable of having a property service connection. The selection of water main used for this purpose is to the discretion of the water business.

- A fully completed Plumbing Application must be submitted to the Relevant Water Business with applicable fees paid and consent given prior to any works being carried out.
- For 20mm and 25mm connections, the water meter will be delivered by the Water Business on the day and at the time of the arranged tapping.
- 32mm and larger water meters are provided to the licensed plumber by the Water Business prior to or on the tapping day. The water meter may be delivered to the property site or to a predetermined location providing it is located within the respective Water Business' licensed boundary.
- The water meter assembly including the containment backflow prevention device must be installed in accordance with these guidelines prior to the connection to the water main being carried out. Some large water meters may take longer to be supplied and therefore customers may need to allow a minimum of 10 days lead time when arranging for the water meters.
- **Water Meter Location** – Positioned at right angles to the water main, above ground and within two metres of the title boundary that abutts to the water main.
- The maximum length of property service pipe is 30m. If a longer connection is required an extension of the water reticulation will be necessary.

Figure 7.1: Drinking Water Wet Tapping

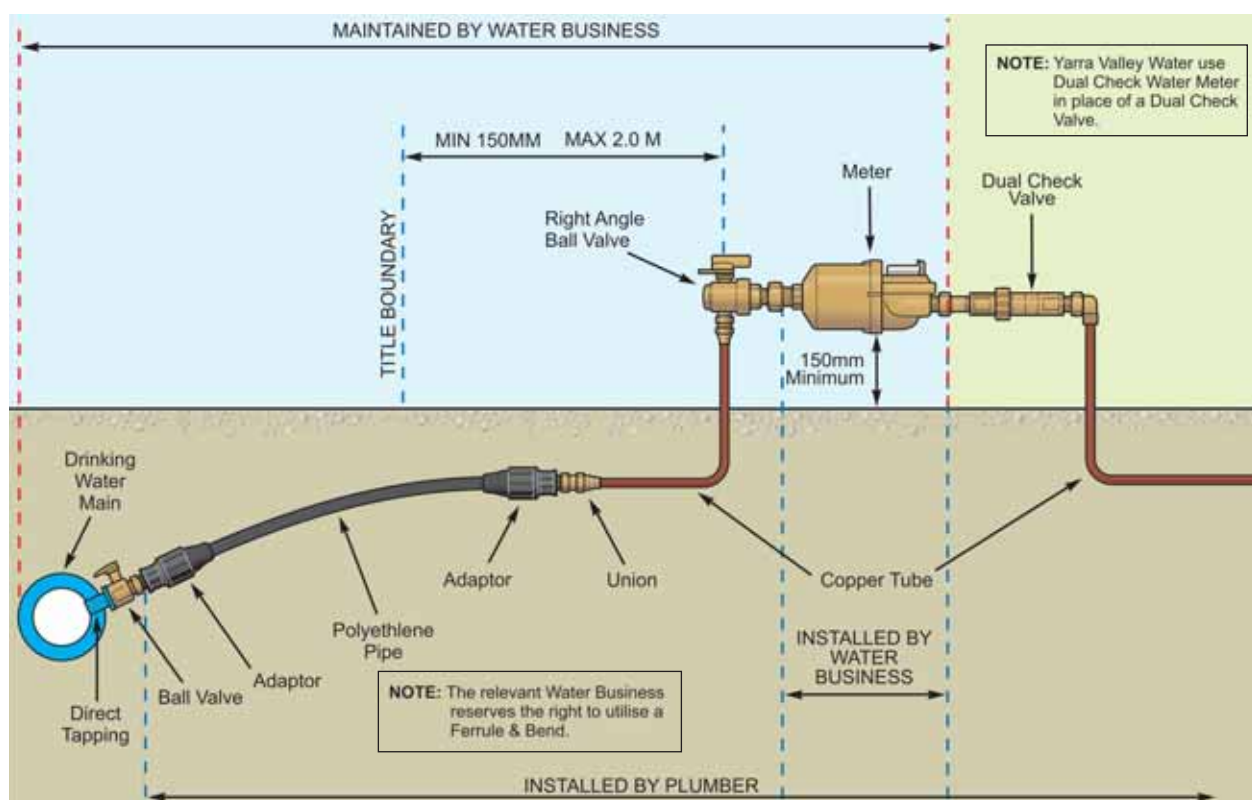


7.2 Dry Tappings for Drinking Water Supply (Residential Only)

The water meter assembly for 20mm Ø dry tappings is installed by the Water Business. Plumbers are not permitted to carry out this work.

- A fully completed Plumbing Application must be submitted to the Relevant Water Business with applicable fees paid and consent given prior to any works being carried out.
- A connection point is provided on the outlet side of the water meter assembly for the plumber to connect the internal water service pipe.
- The location of the dry tapping can be obtained from the Relevant Water Business (a fee may apply).
- In the event that the location of the water meter assembly requires moving by more than 600mm in either direction, the existing tapping is to be plugged at the water main and a new dry tapping provided. This work is to be carried out by the relevant Water Business (fees apply).
- **Water Meter Location** – Positioned at right angles to the water main, above ground and within two metres of the title boundary that abutts to the water main.

Figure 7.2: Drinking Water Dry Tapping

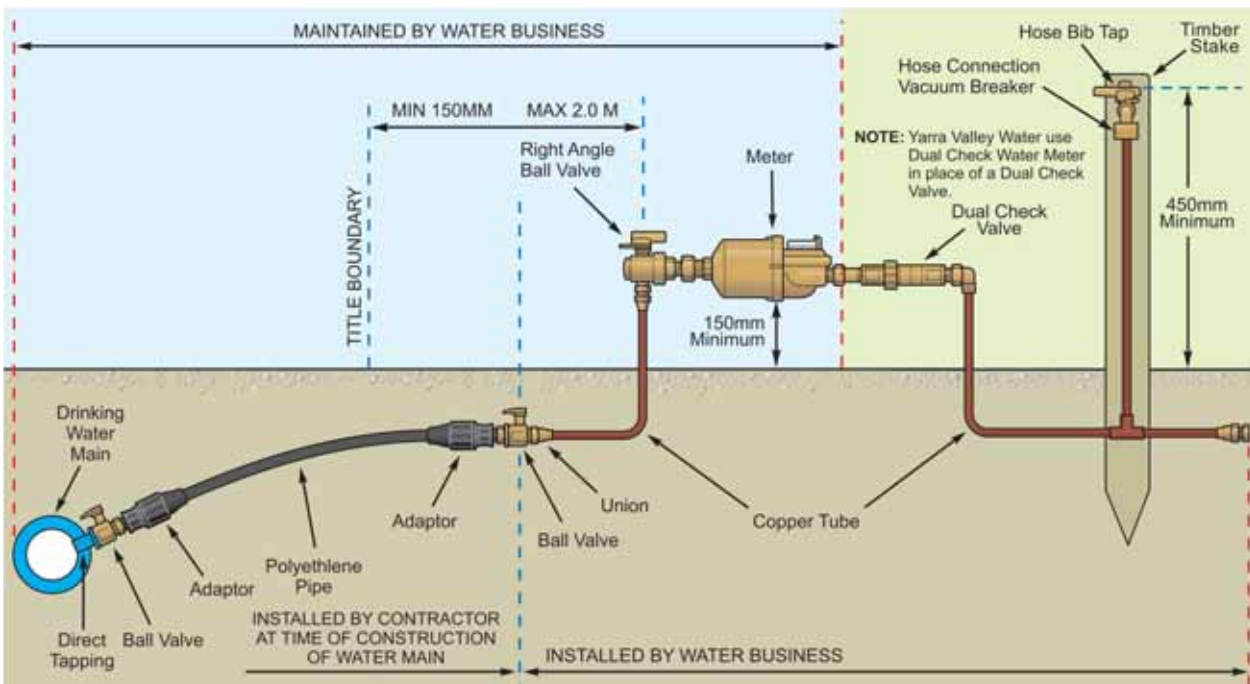


7.3 Dry Tappings for Class A Recycled Water (where available)

The water meter assembly for Class A recycled water dry tapplings is installed by the Water Business. Plumbers are not permitted to carry out this work.

- A fully completed Plumbing Application must be submitted to the Relevant Water Business with applicable fees paid and consent given prior to any works being carried out.
- A connection point is provided after the water meter assembly for the plumber to connect the internal recycled water service pipe.
- The location of the dry tapping can be obtained from the Relevant Water Business (a fee may apply).
- In the event that the location of the recycled water meter assembly requires changing, the existing tapping is to be plugged at the recycled water main and a new dry tapping provided. This work is to be carried out by the relevant Water Business (a fee may apply).
- **Water Meter Location** – always located 300mm to the left of the drinking water meter assembly, positioned at right angles to the recycled water main, above ground and within two metres of the title boundary that abutts to water main.

Figure 7.3: Class A Recycled Water

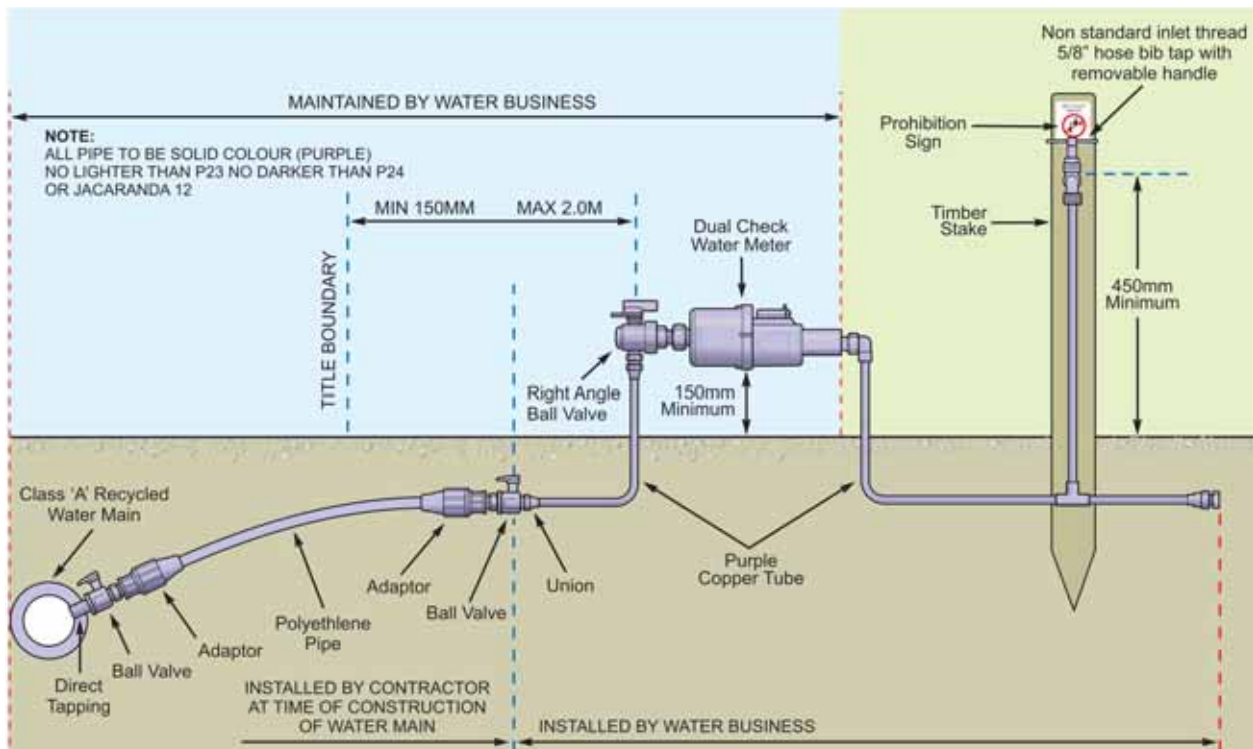

7.4 Tapping Excavations

Unless previously advised the licensed plumber should confirm the tapping time by telephoning the Relevant Water Business or its nominated agents on the working day prior to the tapping.

- Prior to the commencement of any works, the contractor/licensed plumber is required to obtain the location of all services from **Dial Before You Dig (DBYD)** by telephoning 1100.
- The contractor/licensed plumber is required to have the water main exposed with adequate clearance and free of all ground water when the tapper arrives. Allow half an hour each side of **the** tapping time to allow for any unexpected time delays or changes. The **minimum** hole size required for the tapper to do the work is specified in Figure 7.4.
- The water service pipe, water meter assembly, including isolating valve and appropriate backflow prevention device, must be installed prior to the tapping taking place (refer to Water Service Assembly Arrangements).
- Connection to the water main must be at right angles to the intended position of the water meter.
- The contractor/licensed plumber **must be on site at the time of the tapping** and take all precautions necessary for the safety of the excavation including traffic management and the protection of pedestrians.

Note:

- Failure to satisfactorily meet all of the above requirements will result in cancellation of the tapping for that day, making it necessary for the plumber to re-book and pay a re-booking fee.
- Loose polyethylene sleeving (Greensleeve) is used to protect ductile iron water mains against corrosion. The sleeving is essential to prolong the life of the reticulation system and care should be taken when exposing the main to protect this sleeving from damage.


Figure 7.4: Minimum Size of Excavation for Water Trappings and Pluggings

Excavation Requirements



- The contractor is to carry out all excavation requirements and ensure that all Occupational Health and Safety, Trenching, Road Signage, Traffic Management & Road original permits requirements are applied for.
- Obtain location of all other services. Dial Before You Dig by calling 1100.
- Other services may be in the excavation provided they are not on the same elevation as the pipe to be tapped.
- Maximum length from the main to the end of the valve is 450mm.
- The diagrams below show the minimum requirements. If the area is obstructed and prevents an excavation of this size, please contact the relevant Water Business, as they may still be able to work around the obstruction.
- The excavation is to be dry and de-watered by the contractor.
- Any other requirements that are directed to be on side, i.e. tripods etc.
- The contractor is to check 800mm from the centre of the excavation to ensure that there are no pipe collars or any other tappings.

Note:

- Excavations (below) also apply when flushing main and renewing ferrule.
- Proper ground support must be provided for all excavations over 1500mm deep.
- The tapping hole must be free of all ground water.
- Loose polyethylene sleeving (Greensleeve) is used to protect ductile iron water mains against corrosion. The sleeving is essential to prolong the life of the reticulation system and care should be taken when exposing the main to protect this sleeving from damage.

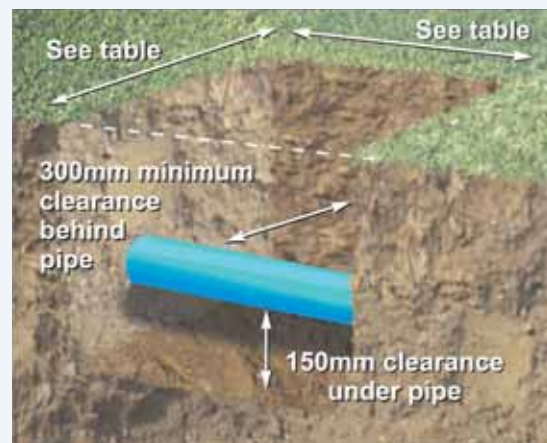

Trench Specifications

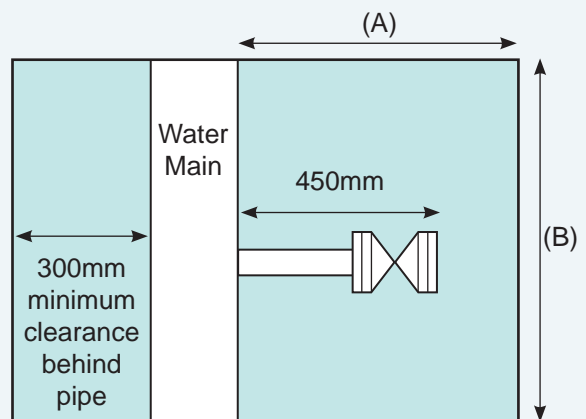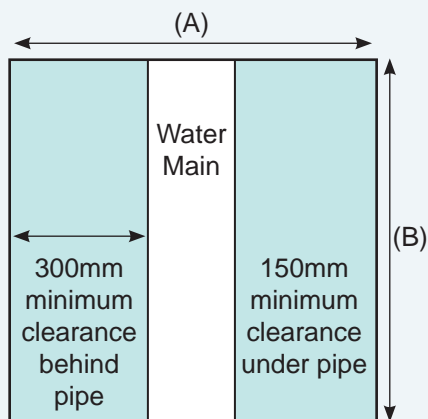

20mm to 50mm Tappings

Main Size = All	Depth to top of main
(A) 1000mm (B) 1000mm	Less than 750mm
(A) 1200mm (B) 1200mm	Between 750-1500mm
(A) 1500mm (B) 1500mm	Over 1500mm

Larger than 50mm Tappings

Main Size	(A)	(B)
80-225mm	1000mm	1000mm
250-300mm	1200mm	1200mm
375-450mm	1500mm	1500mm

7.5 Plug and Re-Tap at the Water Main

For offsetting greater than 600mm, New Developments and Redevelopments.

- If the re-tapping involves only the drinking water meter assembly, the owner is to engage, at their cost a licensed plumber to do the necessary work, with the exception of an actual tapping or plugging.
- A new application (with applicable fee) must be lodged if an existing tapping is to be plugged and re-tapped.
- All excavation works are to be carried out by the owner's licensed plumber.
- Any plug off required is to be carried out at the time of the new tapping being installed.
- Where offsetting has occurred, any reinstatement of paved surfaces is the responsibility of the property owner.
- Where relocation of any Class A recycled water is required, it is to be carried out by the Relevant Water Business.
- Both (drinking water and Class A recycled water) assemblies will be relocated at the owner's cost. The assemblies shall remain 300mm apart with the drinking water meter assembly located on the right hand side.

7.6 Re-Use of Existing Tappings

Existing water tapping and existing property service pipe may be retained where:

- The existing water service is of approved material and is in sound condition (not GWIP).
- The new water meter is provided at owner's expense.
- The tapping is sized appropriately for new development in accordance with table 3.2 of AS/NZS3500.1:2003.

However, if it can be demonstrated that the development's water supply demand does not impact on the performance of the water meter, the following applies:

- Where existing pressures and flows are found to be adequate to service the proposed development (to be substantiated in writing by a hydraulic consultant), the existing property service pipe and water meter may be retained to service the new development.

7.7 Upsizing and Downsizing of Existing Services

- Existing tapplings may be retained where the upsizing/downsizing of the property service pipe is no more than one pipe size.
- The upsizing/downsizing is to occur directly at the first isolation valve located off the water main.
- Full replacement of the property service pipe is to be carried out by the owners' plumber at the owners' expense.
- Only approved polyethylene pipe is to be used for general services up to and including 50mm.
- Services larger than 50mm to be of an approved material in accordance with the Plumbing Regulations incorporating the Plumbing Code of Australia.
- The owner or applicant is responsible to ensure pressures and flows will be adequate and substantiated in writing by a licensed plumber or hydraulic consultant.
- The request for the retention of the existing service must be submitted in writing for approval by the Water Business.

Where the above criteria for retention of the existing tapping can not be satisfied, the existing tapping is to be plugged and an appropriately sized tapping is required in accordance with Clause 7.6.

If the service is 80mm or greater the existing tee or tapping band is to be removed by the Water Business at the owners' expense.

7.8 Sizing of Water Meters and Property Service Pipes

All water meter sizes are to comply with relevant standards. For non-residential developments, the size of the property service pipe to the property is to be determined by the property owner or authorised agent.

7.9 Selection of Water Meters

The selection of the size and type of water meter will be dependent on the required flow rates nominated by the applicant and the intended use of the development.

All water meters used by the Water Businesses for billing purposes are to be of an approved type supplied by the Water Business.

8 OTHER RELATED GUIDELINES

8.1 Backflow Prevention

Water Businesses require all new connections and redevelopments to have an appropriate Backflow Prevention Device fitted at the outlet of the main water meter (Containment Protection) in accordance with Plumbing Regulations incorporating the Plumbing Code of Australia.

- An agreement is required to be executed between the Water Business and the property owner at the application stage.
- If the risk category of a non-residential development is unknown at time of application, the Water Business will require the installation of a high hazard backflow prevention device.
- For single residential properties generally a low hazard Dual Check Valve is required to be installed at the outlet of the water meter.

Note:

- For properties within Yarra Valley Water's operating area a Dual Check water meter is used.

8.2 Remote Water Meters

Remote water meters are to be installed, at the owners' expense. Where pre-arranged access would be necessary in order for the Water Business to read the water meter, it is now no longer acceptable for the customer to supply keys and codes to access any new development. For existing properties it is at the Water Business' discretion to obtain/retain keys and access codes.

- Remote water meters must be installed in new developments of three levels or greater.
- Additional equipment at the owners' cost may be required where the development is greater than four levels.
- When applicable, water meters must have a minimum 150mm distance between the centre of the pipe and any wall and a minimum 250mm distance between the centres of the pipes of each water meter assembly.
- Remote water meters **must not** be located inside the units/apartments, or within the ceiling, wall or floor cavities of common access areas.

8.3 Material for Main to Water Meter Property Service Pipes 20mm to 50mm

Polyethylene pipe (PE100 PN12.5) is required as a minimum and must be WaterMarked.

Note:

- PE pipe is not to form a part of the water meter assembly.

8.4 Material for Main to Water Meter Service Pipes 80mm and Larger

Services greater than 50mm Ø may be installed in any approved material.

8.5 Water Meter Ownership

Water meters are supplied by the Relevant Water Business upon payment of a regulated fee. Once fitted the water meter remains the property of the Relevant Water Business and is maintained and replaced periodically at no cost to the owner unless the owner has altered the water meter surrounds and accessibility to the water meter.

8.6 Damaged, Missing and Stolen Water Meters

If the water meter is damaged, stolen or missing, it will be replaced by the Water Business at the owner's/applicant's expense.

A regulated fee for the supply and installation of the water meter and any other associated works may be charged.

Where the water meter assembly is found to be missing or damaged, the Water Business will provide the owner/applicant 14 days notice to rectify the assembly. Should the owner/applicant not have re-instated the water meter assembly within 14 days, the Water Business will carry out the necessary works and the associated costs will be at the owner's or applicant's cost.

The owner/applicant is required to notify the Water Business as soon as any damage or theft of the water meter has occurred.

8.7 Removal of Water Meters

No person shall remove a water meter or alter its position unless that person has first obtained permission from the respective Water Business to do so. Water meters removed are not to be reused as per the National Measurement Regulations.

If a building is being demolished and an application has not been lodged for a redevelopment of the property, it is a requirement that the service is plugged and the water meter returned to the Relevant Water Business.

8.8 Return of Water Meters

For redevelopments where the service is to be plugged the water meter is to be returned to the tapper at the time of the plugging.

8.9 Use of a Data Logger

Data loggers are not permitted to be fitted to Water Business water meters without prior written consent, which includes a list of conditions which must be met. For details please contact the Relevant Water Business.

8.10 Service Pipes

Where a redevelopment is proposed and the existing property service pipe is of GWI material the property service pipe is to be replaced.

- Only approved polyethylene pipe is to be used up to and including 50mm.
- Any approved material can be used on property service pipes greater than 50mm.

8.11 Pressure Limiting Valve

When the water pressure exceeds 500Kpa at the outlet of the water meter, a pressure limiting valve is required to be installed at the owner's cost in accordance with Plumbing Regulations incorporating the Plumbing Code of Australia.

8.12 Hot Water Meters

Water meters used to measure heated water are not the responsibility of the Water Business.

8.13 Inline Pumping

Inline pumping may be approved, subject to the written approval of the Relevant Water Business. A written request for the approval of variable speed inline pumps must be lodged with the Relevant Water Business, as part of the application for conditions of connection, and should include details of pump curves and pumps to be used.

Note:

- The maximum pump flow should not result in the capacity of the street main being exceeded under peak demand conditions. This must be checked and approved by the Water Business.

8.14 Inline Boosting

The use of inline variable speed electrical pumps to boost supply directly from the local reticulation system may be permitted, subject to approval of the Relevant Water Business.

- A written request for the approval of inline boosting must be lodged with the Relevant Water Business, as part of a tapping request for the development, and should include details of pump curves and pumps to be used.

9 RESPONSIBILITIES

9.1 Property Service Pipes up to and Including 50mm

The Water Businesses are responsible for maintaining the property service pipe where the property service pipe is not of GWI material and not for a fire service (refer to the Water Business' individual Customer Charter).

9.2 Property Service Pipes over 50mm

The property owner is responsible for maintaining the general property service pipe.

9.3 Internal Pipe Work

The property owner is responsible for maintaining all pipe work from the outlet side of the main water meter, including any sub/check meter assemblies. Any sub/check meter purchased from the Water Business remains the property and responsibility of the Relevant Water Business. This does not include private water meters not purchased or accepted by the Water Business.

9.4 Remote Water Meters

The Water Businesses are responsible for maintaining and for the replacement of remote water meters, with the exception of stolen or damaged water meters. See 8.6 for more.

9.5 All Other Services

The Water Business maintains the tee/tapping band including the flange. The owner of the property maintains all other parts of the service. Refer to Figure 10.1.

10 GENERAL WATER AND FIRE SERVICE VALVING ARRANGEMENTS

To be read in conjunction with typical arrangement/standard drawings.


10.1 Grouped Water Meters

Where grouped water meters are to be located for multi unit developments, the owner/owners' corporate is responsible to ensure that each sub/check meter is always tagged with the corresponding unit number.

10.2 Non-Compliant Installations

Where an installation is found to be non-compliant it is the owners' /applicants' responsibility to rectify the installation in accordance with these guidelines and applicable standards within a nominated timeframe given by the Relevant Water Business. Failure to do so may result in the disconnection of the main supply or rectification works will be carried out by the Water Business at owners' /applicants' expense.

Figure 10.1:
Typical Tapping
Under Pressure
Greater than 50mm

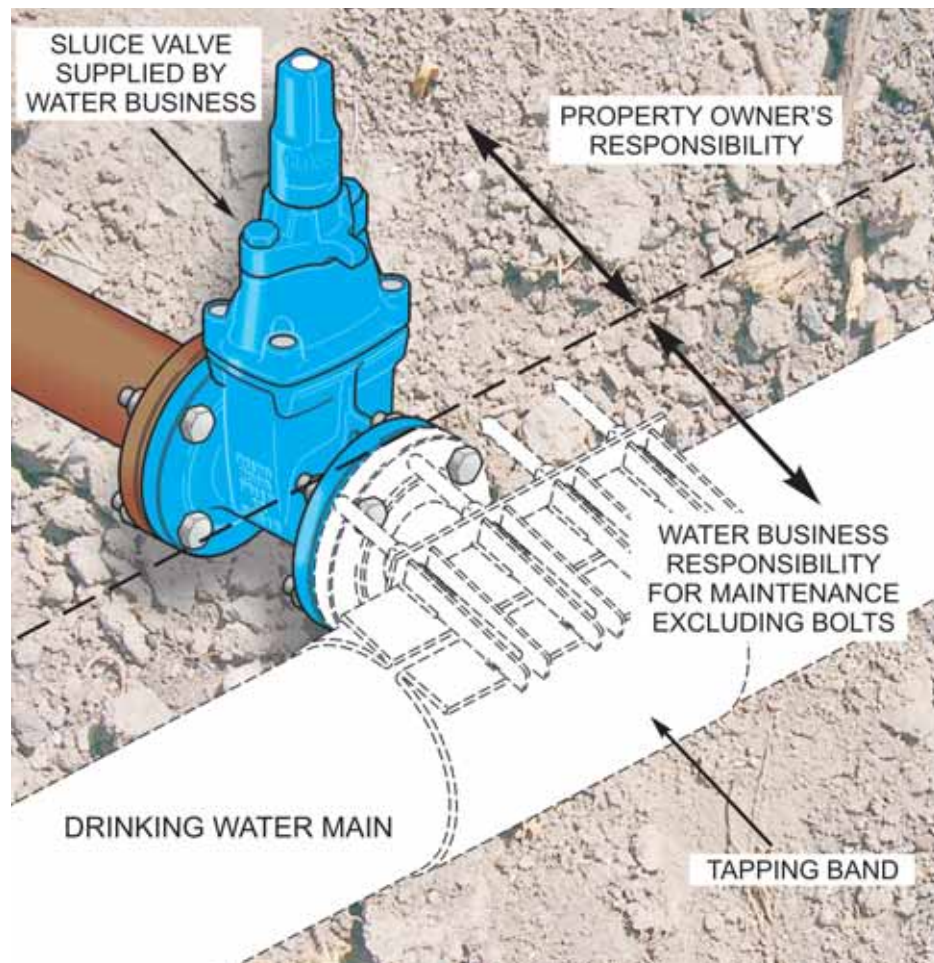

10.3 Fire Services

Water metering of fire services will be assessed on the type, size and use of the development. Typically:

- Hose Reel Services must be metered and are generally supplied via the main metered water service to the property.
- Hydrant Services must be fitted with a WaterMark approved Single Detector Check Valve and an appropriately sized By-Pass water meter supplied by the Water Business.
- Residential/Home Fire Sprinkler Services designed under the AS2118.4 or AS2118.5 which utilises a low volume of water are not required to be metered.
- Where fire systems are designed and installed to AS2118.1 Magnetic Flow Meters will be required.
- **Automatic Fire Sprinkler Services** are required to be metered. The water meter is to be a Magnetic Flow Meter, supplied by the Relevant Water Business. Where a hydrant and fire sprinkler service is required the water meter will register all fire service water used.
 - Water Businesses require a water meter to be installed where a sprinkler system is designed to AS2118.1.
 - The fire system design is to incorporate, all necessary features called for in AS1851:2005 (Maintenance of Fire Protection Systems and Equipment) and/or subsequent versions of AS1851 or equivalent to allow for the monthly testing of the Fire Sprinkler System.
 - Where booster pumps are required, the system is to incorporate recirculating equipment such as storage tanks or other methods to reduce or eliminate the wastage of test water. A minimum of 80% of test water must be recirculated.
 - The metering of fire services with inline water meters requires approval from the applicable fire authority.
 - Water Business may grant approval for recycled water to be used for fire fighting purposes, subject to recycled water quality.

Where the fire service is above 50mm the water supply for general purposes is to be connected off the fire service prior to the fire service water meter and separately metered.

It is recommend that the owner test and maintain the fire service valve external to their property on a yearly basis.

Note:

- For further information please contact the Relevant Water Business.


10.4 Fire Service Pumping

Inline pumping may be approved subject to the written approval of the Relevant Water Business. A written request for the approval of inline boosting must be lodged with the Relevant Water Business, as part of the application for conditions of connection, and should include details of pump curves and pumps to be used.

Note:

- The maximum pump flow should not result in the capacity of the street main being exceeded under peak demand conditions. This must be checked and approved by the Water Business.
- Variable speed pumps in accordance with AS 2941 are preferred, however consideration will be given for the use of direct drive pump sets. In some cases, consideration may also have to be given to installing a break pressure tank to provide added protection to the Water Business water supply infrastructure assets.

Figure 10.2: Typical Boosted Fire Service with Single Check Detector Valve

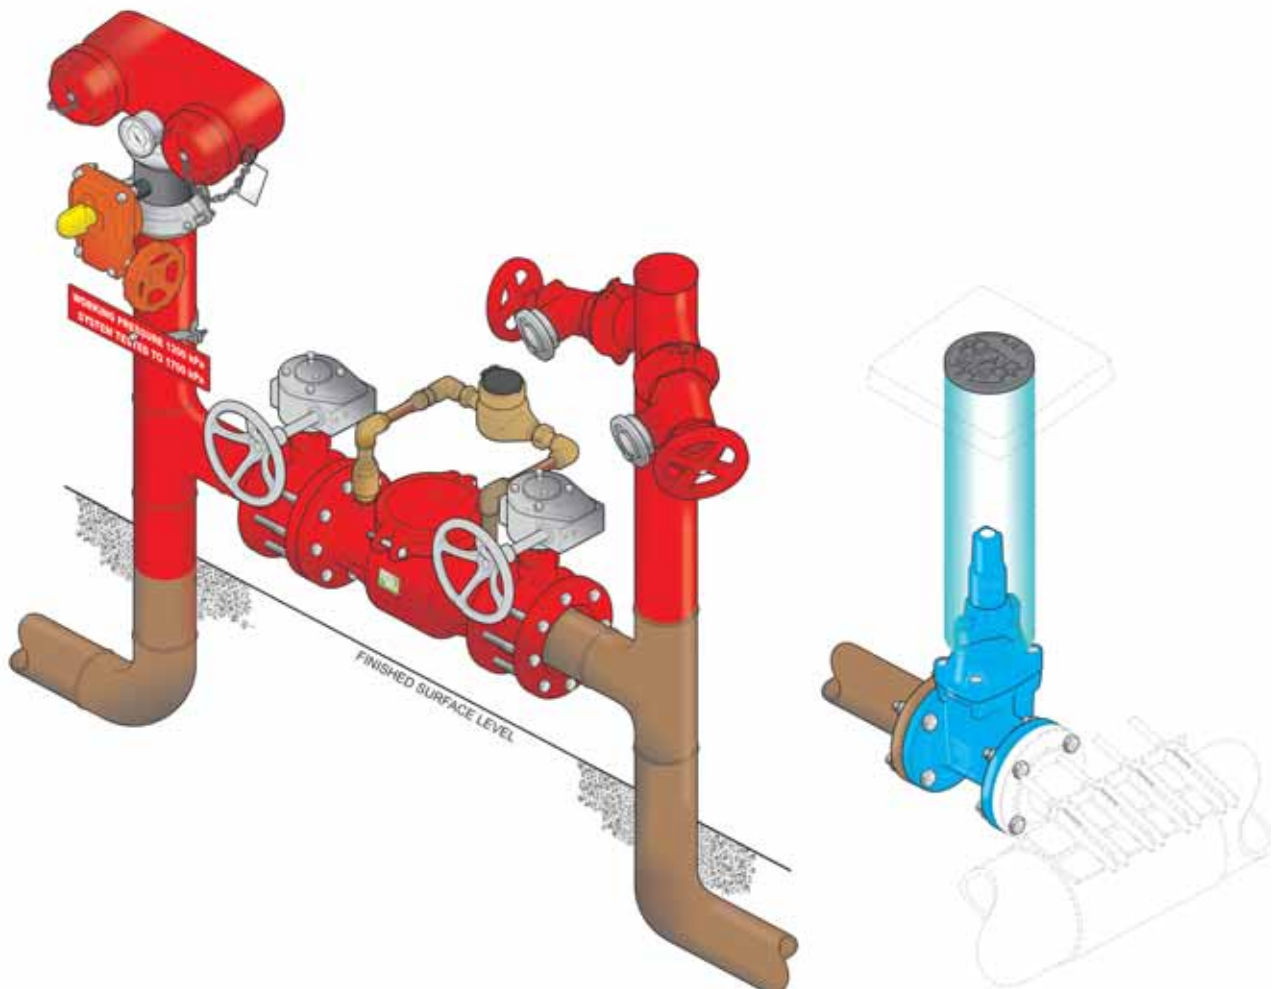


11 RESIDENTIAL WATER METERING AND SERVICING

Water metering and servicing requirements for residential developments are detailed in this section to assist in determining the applicable servicing guidelines related to the proposed development.

11.1 Single Dwelling Residential Development

Definition	<ul style="list-style-type: none"> • House • Terrace house • Strata unit where there is no common land and all units are to be serviced via separate tapplings.
Water Metering	<ul style="list-style-type: none"> • A main water meter is mandatory on the drinking water supply and also on the recycled water supply where available. • Water meters must be readily accessible for reading, maintenance and replacement. Where the water meter is deemed to be inaccessible for reading, remote water meters will be required to be fitted (see section 8.2 - Remote Water Meters).
Servicing	<ul style="list-style-type: none"> • 20mm Ø tapping is required. • For dry tapplings, the water meter assembly and water meter are to be installed by the Water Business (generally lots created after 1992 are dry tapped - see definition). • For wet tapplings, the plumber is to install the water meter assembly and property service pipe prior to the tapping time. The Water Business taps the water main (see definitions). • Upsizing of the property service pipe may be approved following an assessment based on the required flow rate. Additional fees apply. <p>Note: All 20mm water connections within recycled water areas are to be installed by the Water Business at a cost. This includes the installation of the property service pipe, water meter assembly and water meter.</p>


Figure 11.1:
Drinking Water &
Class A Recycled
Water

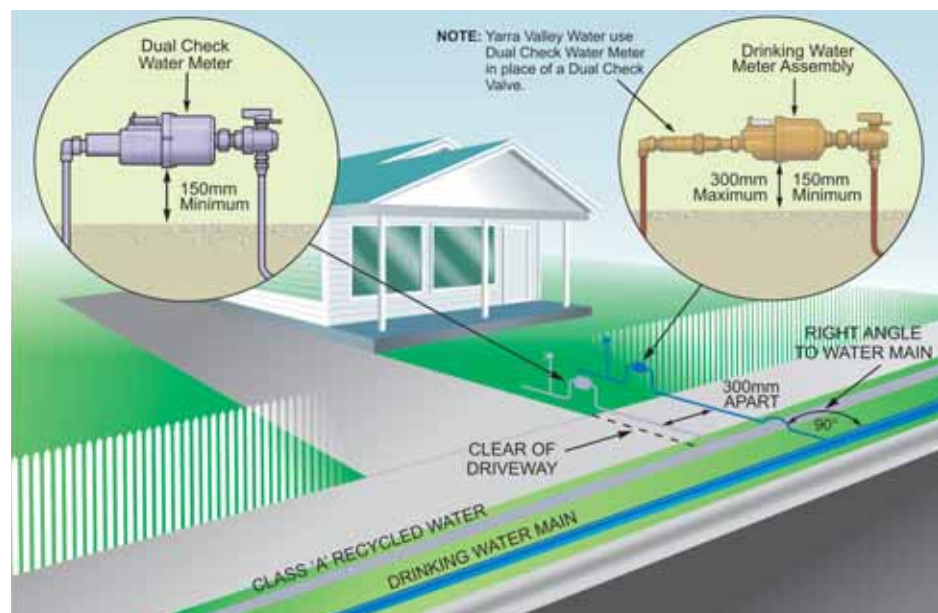

11.2 New Dual Dwelling Residential Development

Where both dwellings have water main frontage:	
Definition	Two dwellings on a residential parcel/s of land
Water Metering	<ul style="list-style-type: none"> For each dwelling a new main water meter is mandatory on the drinking water supply and also on the recycled water supply where available.
Servicing	<ul style="list-style-type: none"> Separate 20mm Ø tapplings are required to service each dwelling. An existing 20mm Ø tapping may be retained for one dwelling if approved by the Water Business. For wet tapplings, the plumber is to install the water meter assembly and property service pipe prior to the tapping time. The Water Business taps the water main (see definitions). Upsizing of the property service pipe may be approved following an assessment based on the required flow rate. Additional fees apply.


Figure 11.2: Typical Dual Occupancy Residential Development

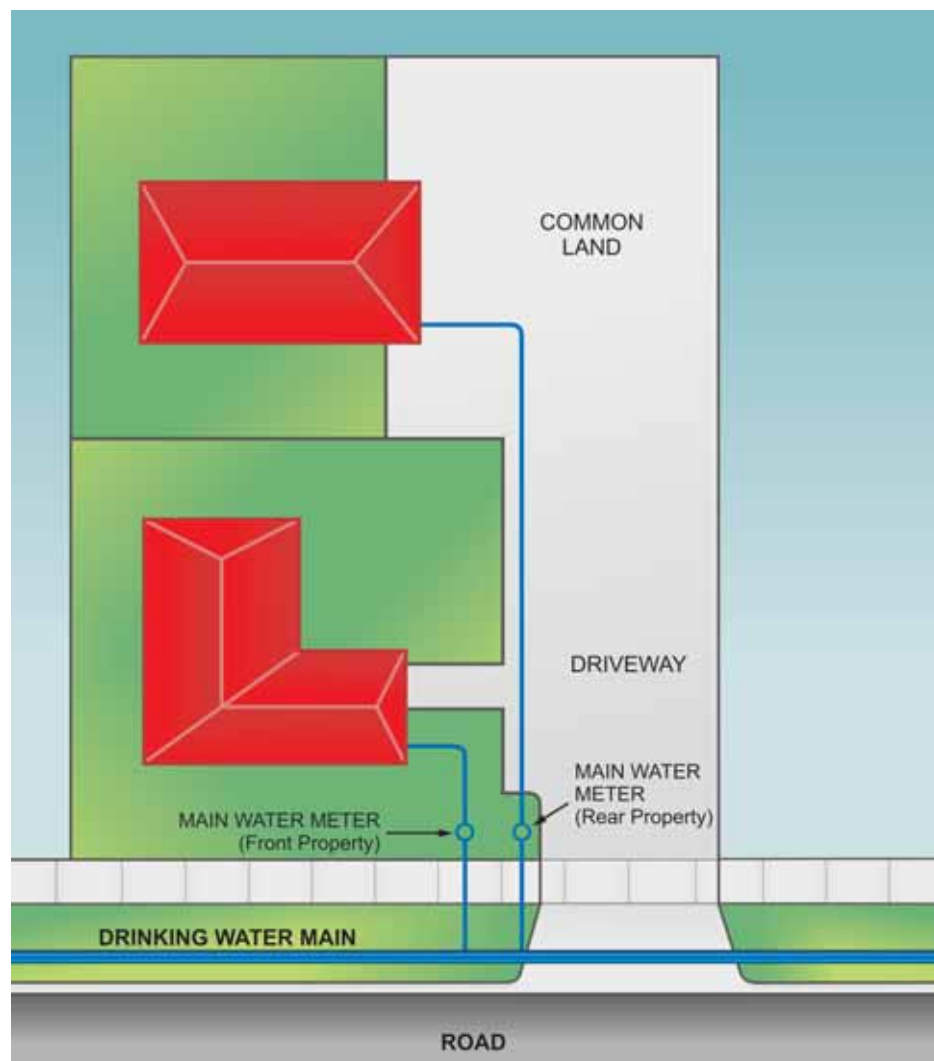

Where only one dwelling has water main frontage (either for new dwellings or a proposed second dwelling):

Definition	Two dwellings on a residential parcel/s of land
Water Metering	<ul style="list-style-type: none"> • A main water meter is required (generally 25mm) on the drinking water supply and also on the recycled water supply when available to service both dwellings. • For each dwelling a sub/check meter is required on the drinking water supply and also on the recycled water supply when available.
Servicing	<ul style="list-style-type: none"> • To be serviced by 25mm tapping and main water meter with sub/check meters on each unit. An existing 20mm tapping is to be plugged. • When upsizing a service, where possible, one size up from the ferrule/ ball valve is acceptable (refer to clause 7.8). • For wet tapings, the plumber is to install the water meter assembly and property service pipe prior to the tapping time. The Water Business taps the water main (see definitions). • Upsizing of the property service pipe may be approved following an assessment based on the required flow rate. Additional fees apply.

Figure 11.3: Typical Dual Occupancy Where Only One Dwelling has Water Main Frontage

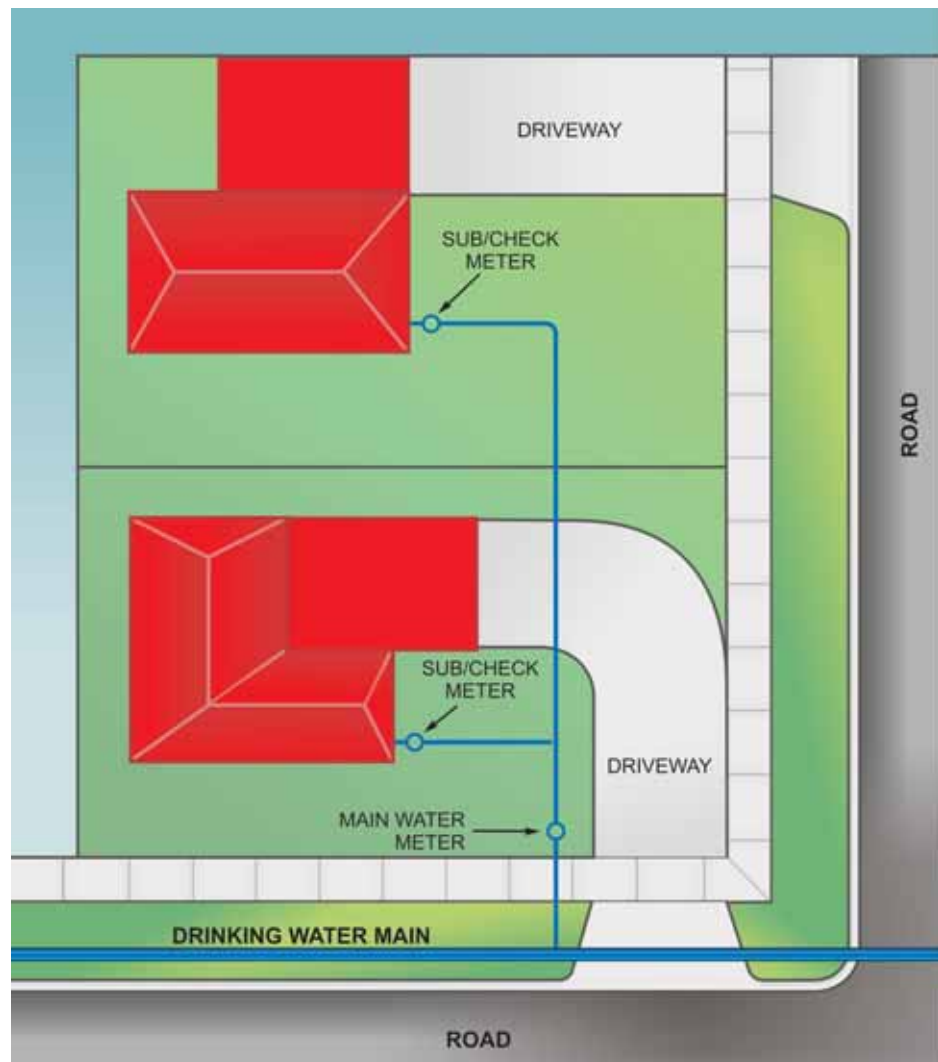

Existing dual occupancies constructed prior to 1997

Definition	With many existing developments, generally constructed prior to 1997 only a main water meter was provided with the water usage divided among the owners of the individual dwellings. In these cases some owners wish to install individual water meters to allow them to monitor their water usage.
Water Metering	These developments are typically serviced by a 20mm Ø main water meter. Additional sub/check meters to each dwelling are able to be provided (for a fee) subject to the servicing requirements listed below.
Servicing	<p>Option 1</p> <ul style="list-style-type: none"> • Separate tapplings for each dwelling. The existing 20mm tapping and water meter is to be retained for one dwelling with a new 20mm tapping and water meter being provided for the second dwelling). <p>Option 2</p> <ul style="list-style-type: none"> • The existing 20mm Ø water service tapping is to be plugged. A new 25mm Ø tapping and water meter with 2 x 20mm Ø sub/check meters to be provided to each dwelling. <p>Option 3</p> <ul style="list-style-type: none"> • The existing 20mm Ø tapping and property service pipe is to be retained and the existing 20mm Ø main water water meter to remain in place with 2 x 20mm Ø check/sub meters to be provided to each dwelling. Existing pressures and flows are to be proven adequate and substantiated in writing by a hydraulic consultant. <p>Note: If the current or proposed demand for water supply affects the performance of the 20mm main water meter, option 3 will not be acceptable. This is to be determined by the Relevant Water Business.</p>

Figure 11.4: Existing Dual Occupancy Developments with a main meter only

Option 1:

Retain existing 20mm tapping and water meter for occupancy 1. Provide second 20mm tapping and main water meter for the second occupancy.

Option 2:

- Plug existing 20mm water service tapping. Provide new 25mm tapping, property service pipe and 25mm water main.
- New sub/check meters to each occupancy.

Option 3:


- Where sufficient flow exist and have been substantiated in writing by a hydraulic consultant, the existing 20mm property service pipe and 20mm main water meter may be retained and a 20mm sub/check meter provided for each dwelling.

Note:

- This option only applies for existing units, not new.

Or


- Plug existing 20mm water service tapping and install new 25mm tapping and property service pipe where insufficient flow exist.
- New sub/check meters for each occupancy.

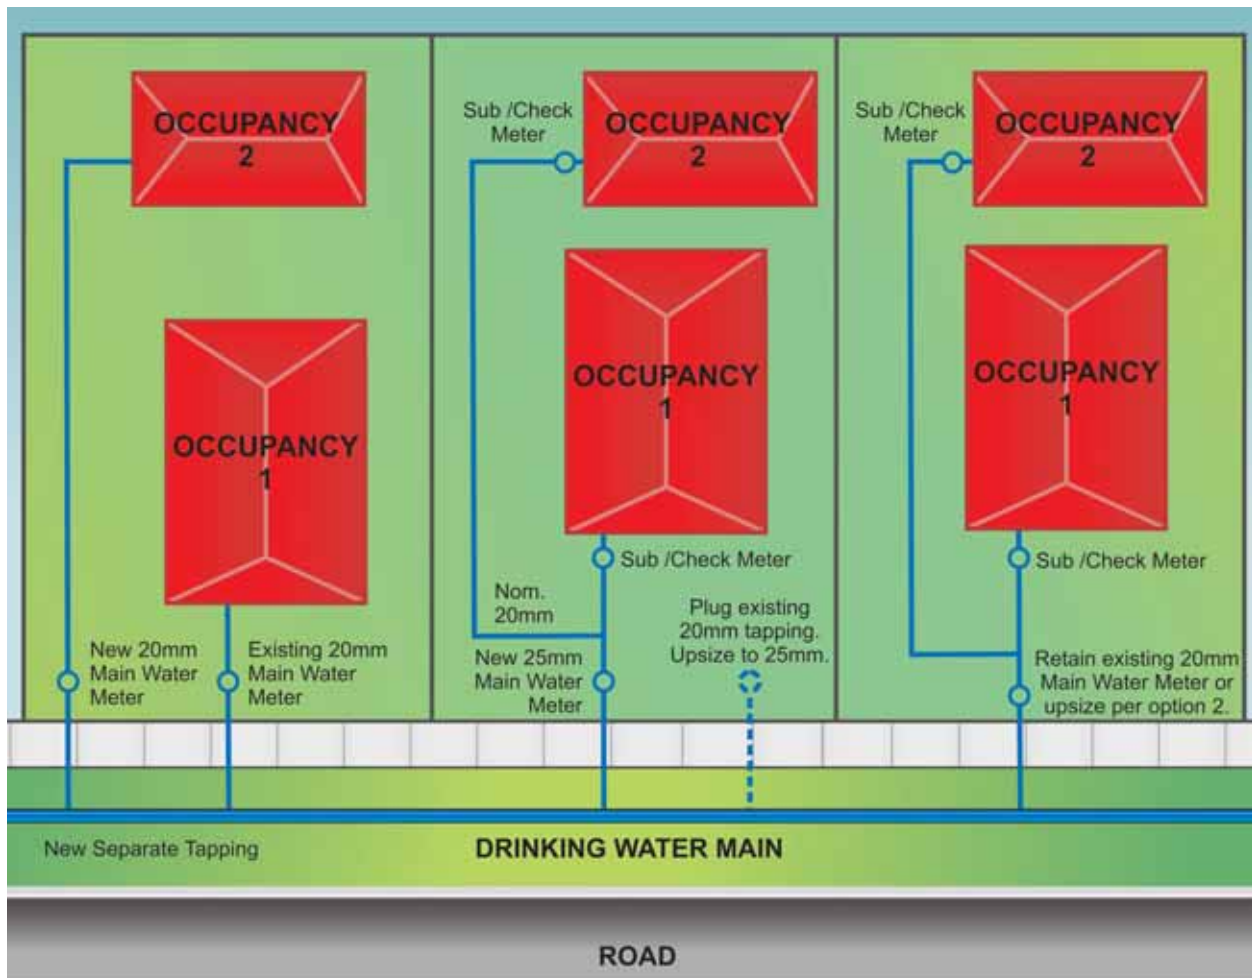

11.3 Multi-Dwelling Residential Development (Greater than two units and less than 20 units ground floor/ground and first floor)

Definition	Multiple dwellings on a single title or Owners Corporation: <ul style="list-style-type: none"> • Flats. • Apartments. • Units.
Water Metering	<ul style="list-style-type: none"> • A main water meter is required on the drinking water supply and also on the recycled water supply where available to service all dwellings. • For each dwelling a sub/check water meter is required on the drinking water supply and also on the recycled water supply where available. • Water meters must be readily accessible for reading, maintenance and replacement. Where the water meter is deemed to be inaccessible for reading, remote water meters will be required to be fitted (see section 8.2 - Remote Water Meters).
Servicing	<ul style="list-style-type: none"> • A single tapping is to be provided to service the total development. • Upon application, second tapping will be considered where a dual supply arrangement is proposed and the services are to be interconnected. • Existing services are to be plugged with all dwellings to be serviced from the same main water meter. • Dual supply from water mains in different pressure supply zones will not be permitted.
Fire Services	Refer to Section 10.6
Additional References	See Melbourne Metropolitan Water Business 'Water Service Assembly Arrangements'.

Figure 11.5: Typical Multi-Dwelling Residential Development

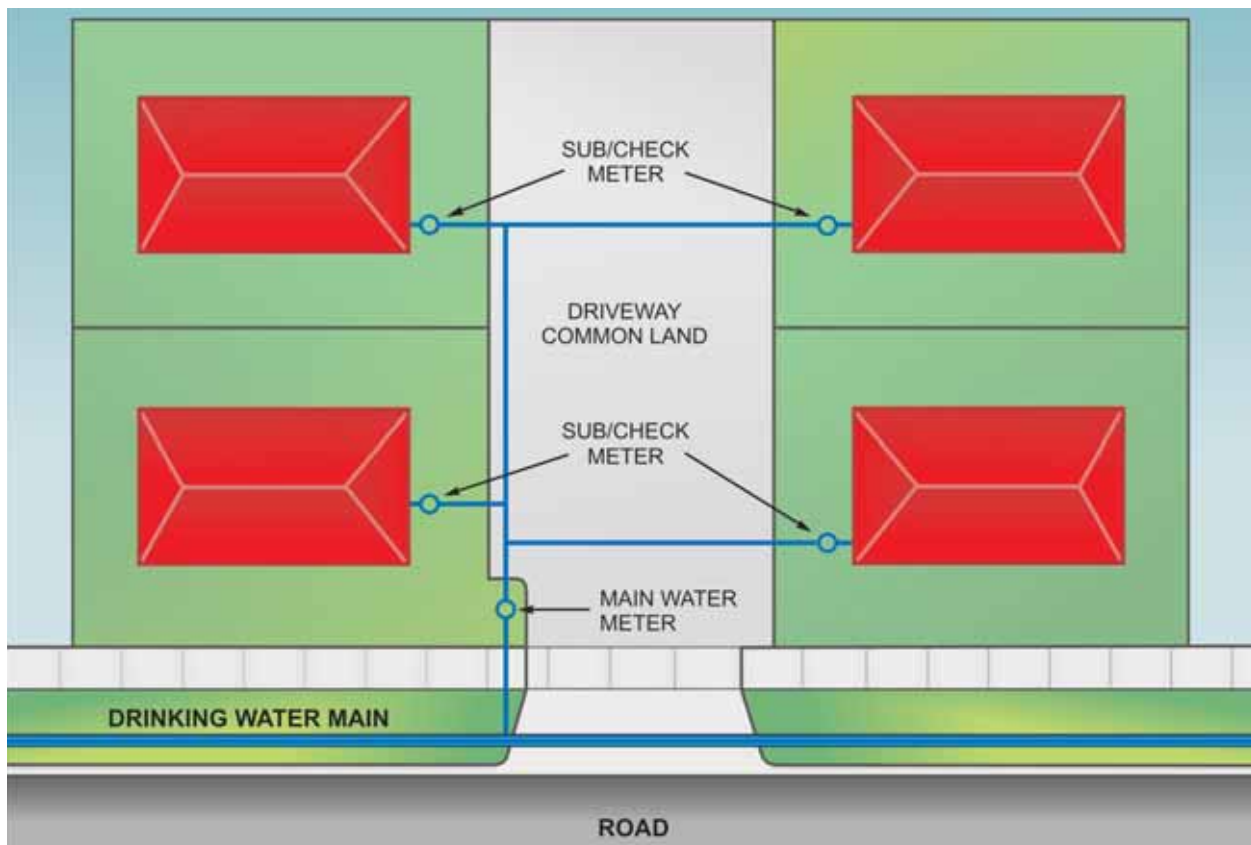

11.4 Multi-Dwelling Residential Development (Greater than 19 units ground floor/ground and first floor)

Definition	<ul style="list-style-type: none"> • Retirement Villages (separate units, not high rise, separately titled). • Ground floor units.
Servicing	Refer to the Relevant Water Business.

11.5 Multi-Dwelling Residential Development (High Rise multi dwelling, greater than two floors)

Definition	Multiple dwellings on a single title or Owners Corporation: <ul style="list-style-type: none"> • Flats • Apartments • Units
Water Metering	<ul style="list-style-type: none"> • A main water meter is required on the drinking water supply and also on the recycled water supply where available to service all dwellings/units. • For each dwelling/unit a remotely read sub/check water meter is required on the drinking water supply and also on the recycled water supply where available. • Additional water meter reading equipment may be required for developments over four levels. • Refer to Section 6 - Water Metering Positioning.
Servicing	<ul style="list-style-type: none"> • A single tapping is to be provided to service the total development. • On application, a second tapping will be considered where a dual supply arrangement is proposed and the services are to be interconnected. • Existing services are to be plugged with all dwellings to be serviced from the same main water meter. • Dual supply from water mains in different pressure supply zones will not be permitted.
Fire Services	See Section 10.6
Additional References	See Metropolitan Water Business 'Water Service Assembly Arrangements'.

11.6 Dependent Living Residential Units ('Granny Flat')

Definition	<ul style="list-style-type: none"> • A self-contained building erected on the land of the property owner, and is used or intended to be used as a separate residence from the main residence. The dwelling must contain kitchen, bathroom and sanitary facilities, the requirements of which are outlined below. The occupier of the dwelling has the right to exclusive use, but does not need to have paid or contributed to the purchase price of the dwelling. • Evidence is required that the person/s residing or intending to reside in the dwelling is/are in fact a dependent relative for it to be so classified. <p>Source: - Based on the definition of 'dwelling' in s 46H of the Planning and Environment Act (Vic) 1987.</p>
New Customer Contributions	<p>Where the proposed development satisfies the definition of 'dwelling' under the provisions of the Planning and Environment Act 1987, or the applicant requests separate water meters, new customer contributions will apply. The fee will be charged in line with Essential Services Commission Determination requirements.</p>
Property Declaration	<p>In cases where the development does not meet the definition of a 'dwelling' under the provisions of the Planning and Environment Act 1987 No. 46H, and the customer does not require separate water meters for the proposed building, the owner will be required to enter into an agreement with the water authority by signing a 'Declaration Form'. The agreement will provide for payment of new customer contributions only when the property is subdivided in the future or provided with separate water meters at the request of the property owner.</p>
Water Metering	<p>Individual sub/check metering of the dwelling is optional. Water meters must be readily accessible for reading, maintenance and replacement. Where the water meter is deemed to be inaccessible for reading, remote read water meters will be required to be fitted (see section 8.2 - Remote Water Meters).</p>
Servicing	<p>These developments may be serviced in several ways:</p> <ul style="list-style-type: none"> • Separate tappings for each dwelling. • Upsize existing 20mm Ø property service pipe to 25mm. A 25mm main meter with sub/check meters to each dwelling. <p>However, if it can be demonstrated that the development's increased demand for water supply does not impact on the performance of the water meter, the following applies:</p> <ul style="list-style-type: none"> • Where existing pressures and flows are found to be adequate (to be substantiated in writing via a licensed plumber or hydraulic consultant), the existing property service pipe may be retained to service both dwellings. <p>Note: Where the development does not meet the definition of a 'dwelling' under the provisions of the Planning and Environment Act 1987 No. 46H, sub/check metering arrangements will not be required, and the existing service may be utilised.</p>

11.7 Moveable Residential Units (DoH 'Granny Flats')

Definition	<p>Provided by the DoH and deemed by Section 15 of the Housing Act 1983 as owned by the DoH, in the occupation of hirer, and is not a permanent fixture on the property. DoH to provide the Water Businesses with an approved plan for endorsement.</p>
Water Metering	<p>Not to be individually metered.</p>

11.8 Residential Caravan Parks

Definition Section 156 (3A) of the Local Government Act provides: “For the purposes of this Part and Part II of the Valuation of Land Act 1960, a caravan park is a single rateable property of which the caravan park owner is taken to be the occupier”.

Water Metering Not to be individually metered.

Figure 11.6: Dependent Persons Residential Units


New Customer Contributions Payable

Option 1:
Separate meters may be supplied via separate tapplings.

Option 2:
Plumber/consultant report required. Plug existing 20mm water service tapping and install new 25mm tapping and property service pipe where insufficient flows exist.

New Customer Contributions Deferrable-Dependant Persons Unit Declaration From Applicable

Option 3:
No subdivision.
No request for separate meters.
Plumber/consultant report required.
Plug existing 20mm water service tapping and install new 25mm tapping and property service pipe where insufficient flows exist.

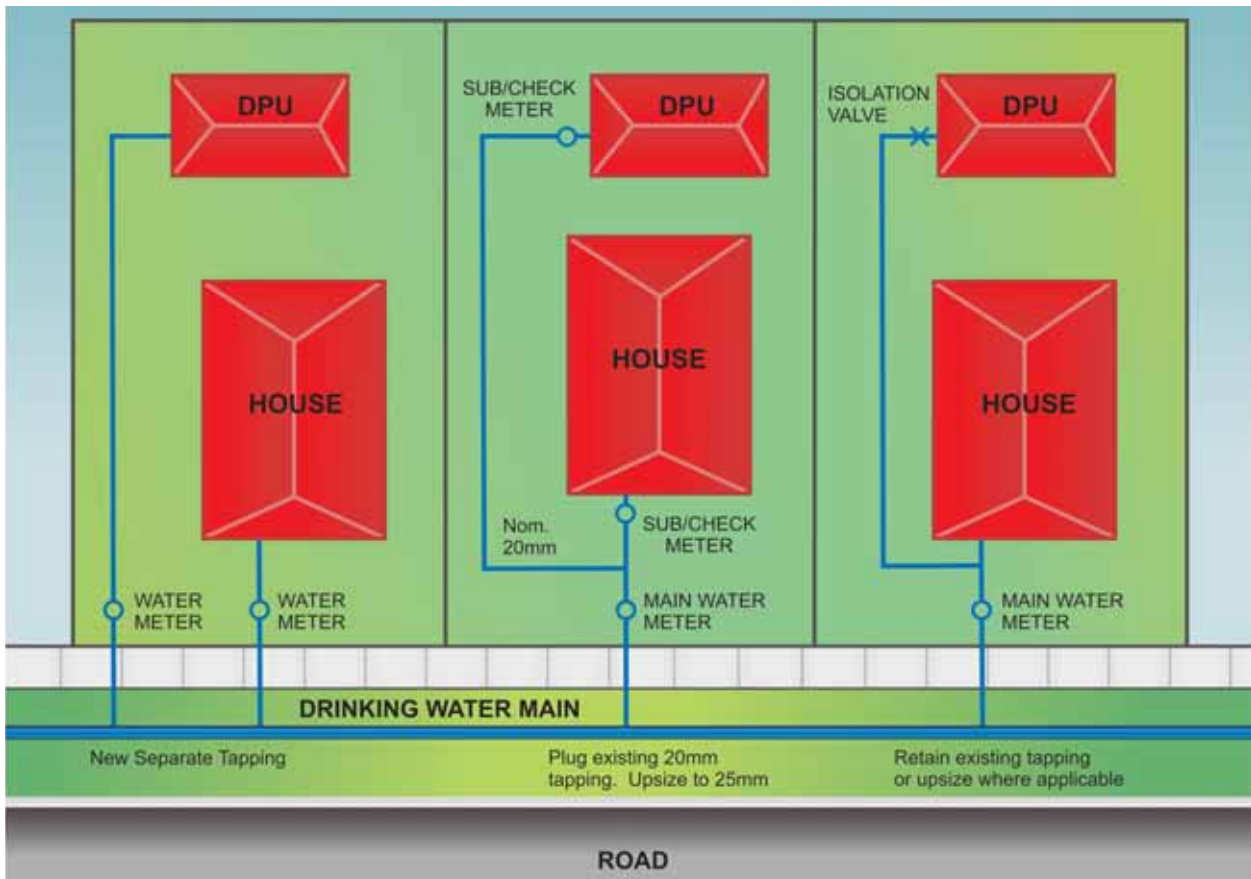

12 NON-RESIDENTIAL WATER METERING AND SERVICING


Water metering and servicing requirements for non-residential occupancies are detailed in this section to assist in determining the applicable servicing guidelines related to the proposed development.

All properties not classified as either residential or mixed developments are non-residential.

12.1 Single Occupancy Non-Residential Development

Definition	<p>Parcels of land or developments where all of the “occupancies” located on the parcel of land are for non-residential purposes:</p> <ul style="list-style-type: none"> • Factories • Warehouses • Shops • Offices • Schools • Hospitals • Sporting Facilities • Childcare Centres • Nursing Homes • Council Building • Irrigation Systems <p>Note: Developments that have a mixture of “occupancies” used for non-residential purposes and of “occupancies” used for residential purposes are dealt with in section 13 (Mixed Developments).</p>
Water Metering	<ul style="list-style-type: none"> • A main water meter is required on the drinking water supply and also on the recycled water supply where available. • Meters must be readily accessible for reading, maintenance and replacement. Where the water meter is deemed to be inaccessible for reading, remote water meters will be required to be fitted (see section 8.2 - Remote Water Meters).
Servicing	<ul style="list-style-type: none"> • A single tapping is to be provided to service the total development. • Upon application, a second tapping will be considered where a dual supply arrangement is proposed and the services are to be interconnected. • Dual supply from water mains in different pressure supply zones will not be permitted.
Fire Services	Refer Section 10.6
Additional References	See Metropolitan Water Business ‘Water Service Assembly Arrangements’.


Figure 12.1: Single Occupancy Non-Residential Development

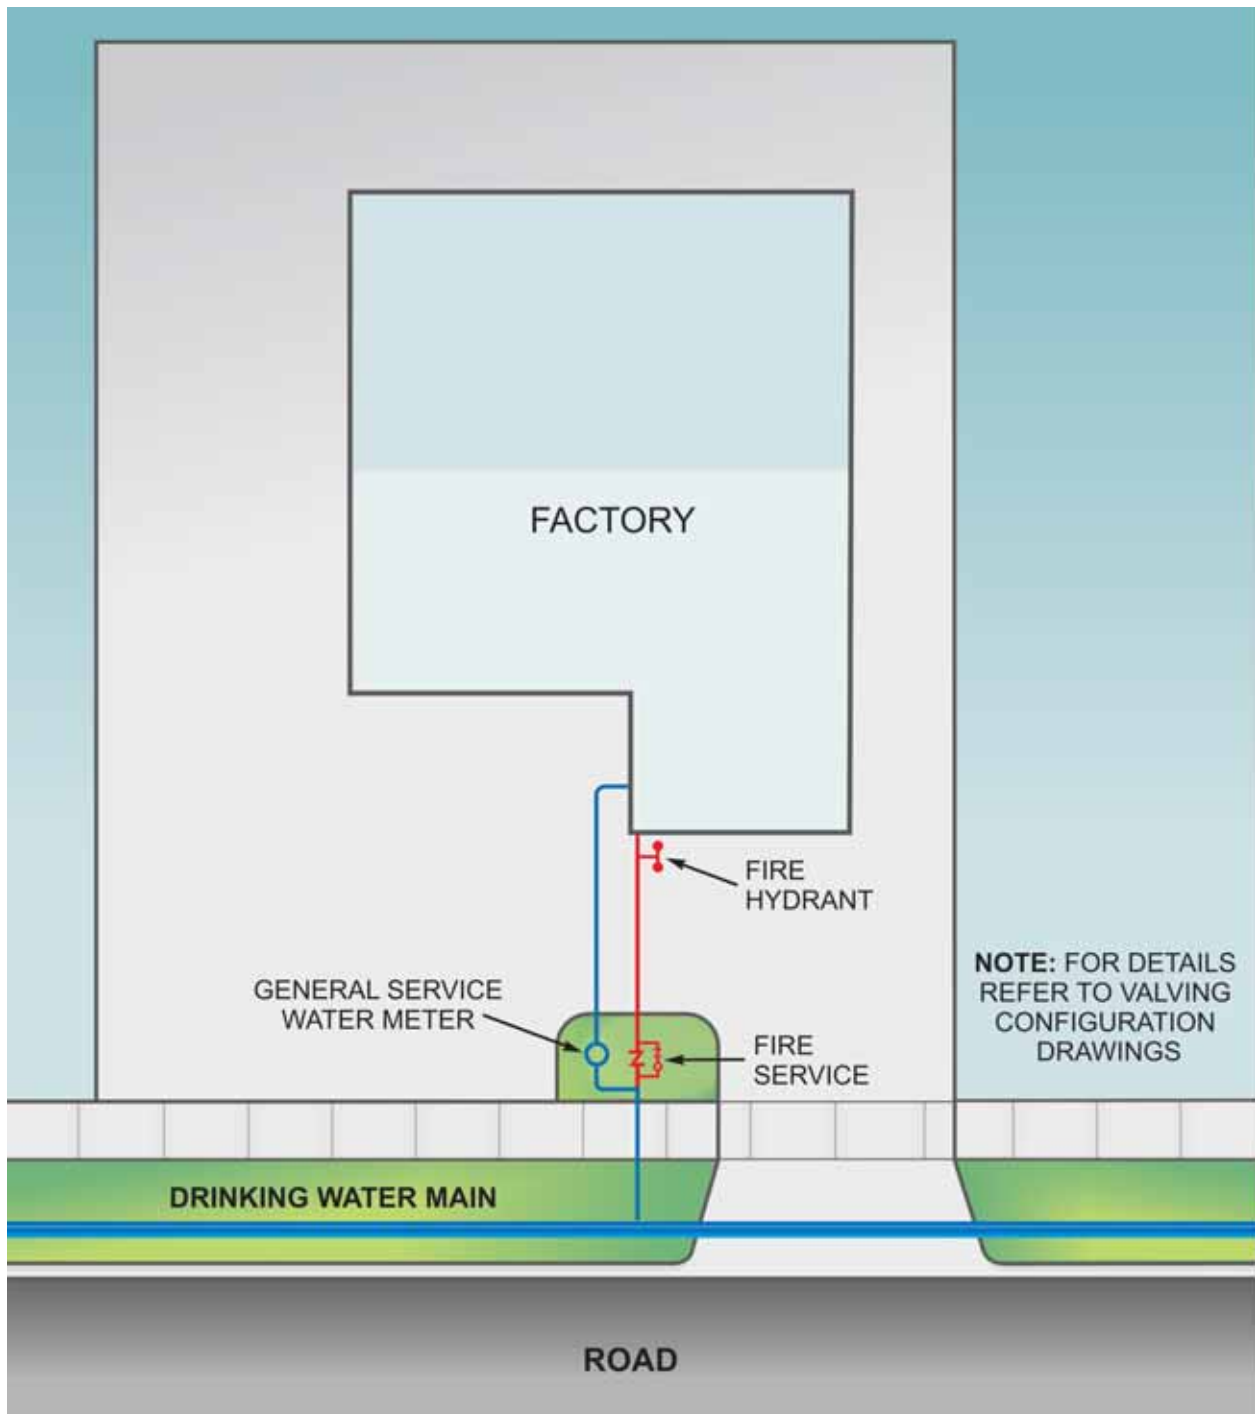

12.2 Multi-Occupancy Non-Residential Development

Definition	<p>Parcels of land or developments where all of the “occupancies” located on the parcel of land are for non-residential purposes:</p> <ul style="list-style-type: none"> • Factoryettes • Strip shops (all shops have a separate frontage to street). • Multiple Sporting Facility Complexes
Water Metering	<ul style="list-style-type: none"> • A main water meter is required on the drinking water supply and also on the recycled water supply where available. • For each occupancy a sub/check water meter is required on the drinking water supply and also on the recycled water supply where available. • For multi level developments greater than two floors, remote sub/check water meters are required. • Additional meter reading equipment may be required for developments over four floors (see section 8.2 – Remote Water Meters).
Exceptions	<ul style="list-style-type: none"> • Large shopping centers (each respective Water Business encourages water metering of these developments, however specific requirements apply). • Office blocks. • Serviced apartments. Where a lease arrangement is in place that the development will be operated as a motel, the meter assemblies will be required, however the installation of water meters will not be required. • Student accommodation. Where a lease arrangement is in place that the development will be operated as a single entity, the meter assemblies will be required, however the installation of water meters will not be required. • Motels. Where a lease arrangement is in place that the development will be operated as a motel, the meter assemblies will be required however the installation of water meters will not be required. <p>Note: Water Business encourage water metering of these development types however it is not compulsory.</p>
Servicing	<ul style="list-style-type: none"> • A single tapping is to be provided to service the total development. • Upon application, a second tapping will be considered where a dual supply arrangement is proposed and the services are to be interconnected. • Dual supply from water mains in different pressure supply zones will not be permitted.
Fire Services	Refer to Section 10.6
Additional References	See Metropolitan Water Business ‘Water Service Assembly Arrangements’.

Figure 12.2: Multiple Occupancy/Non-Residential Development

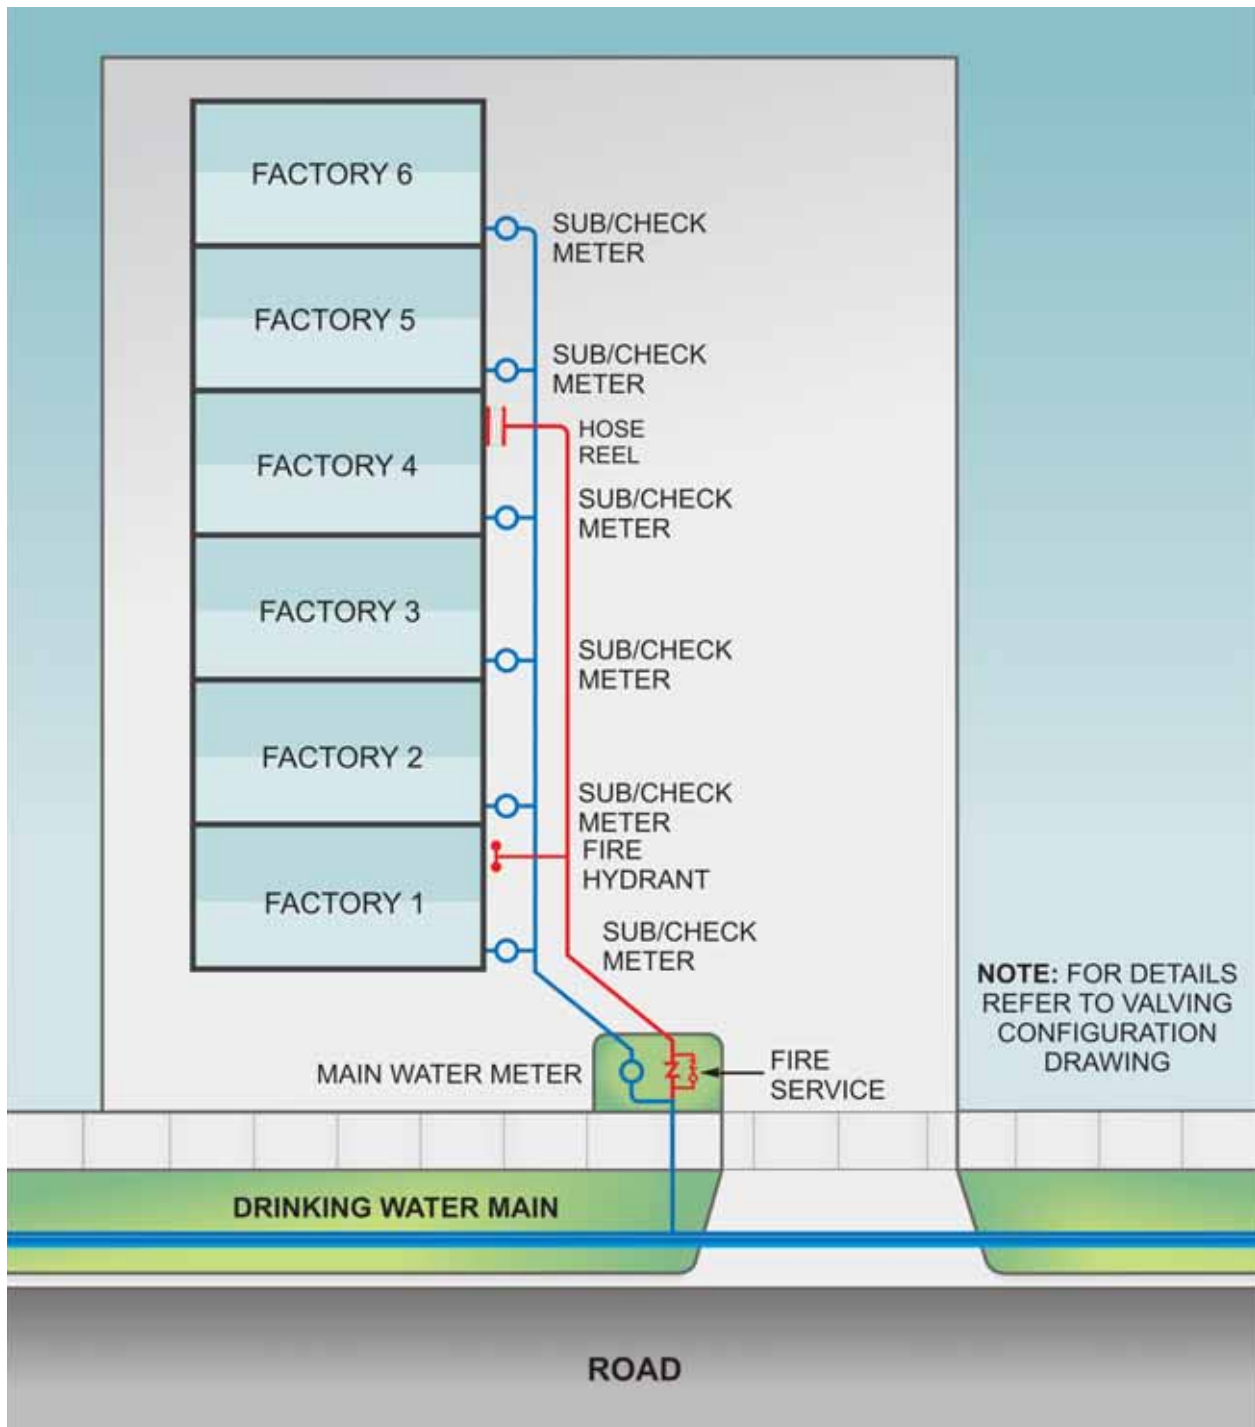


13 WATER METERING IN SPECIAL CASES

13.1 Mixed Developments

Definition	Parcels of land or developments that have within their title boundary 'dwellings'/'occupancies' used for both residential and for non-residential purposes.
Water Metering	<ul style="list-style-type: none"> • Using the definitions in section 5, all 'dwellings'/'occupancies' that are deemed to be self contained must have their supply individually sub/check metered. • For multi-level developments of three floors or more, remote sub/check water meters are required. • Additional water meter reading equipment may be required for developments over four floors, not including a basement (see section 8.2 – Remote Water Meters).
Servicing	<ul style="list-style-type: none"> • A single tapping is to be provided to service the total development. • On application a second tapping will be considered where a dual supply arrangement is proposed and the services are to be interconnected. • Dual supply from water mains in different pressure supply zones will not be permitted.
Fire Services	Refer to Section 10.6
Additional References	See Metropolitan Water Business 'Meter/Pipeline Configuration Drawings'.


Figure 13.1: Typical Mixed Development

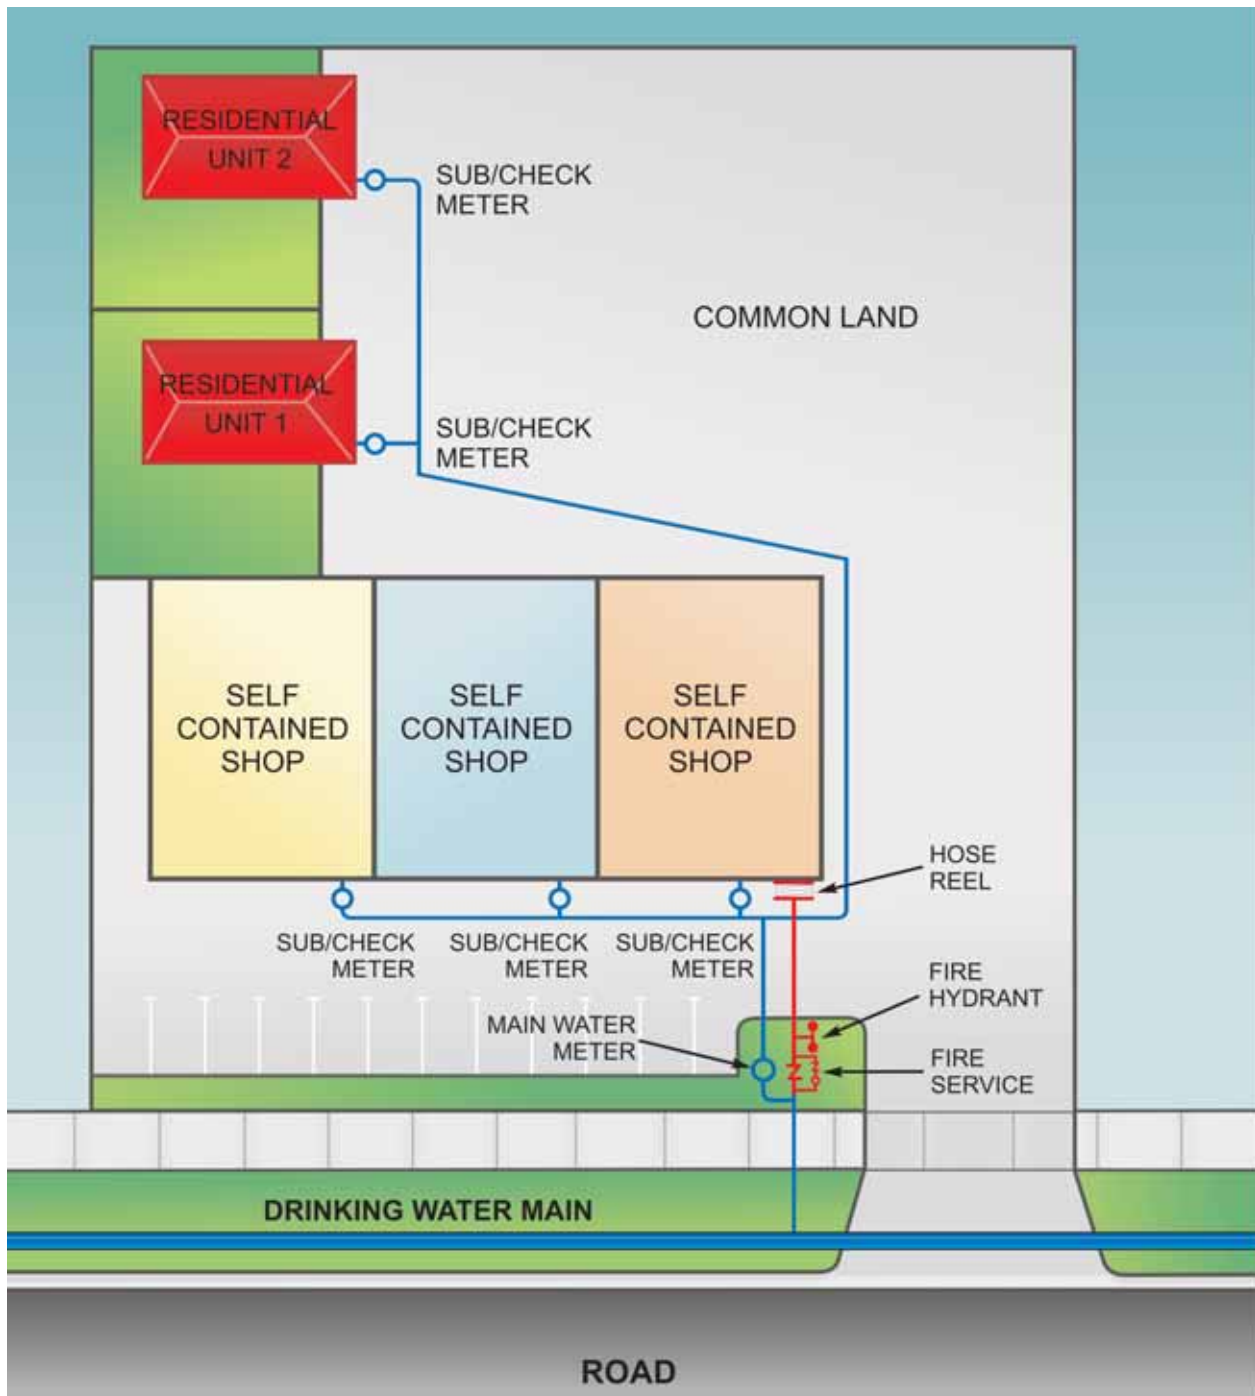

13.2 Additional Units or Factoryettes to Existing Developments

Definition	Where additional units or factoryettes are added to existing developments that are not individually metered; these types of developments will be treated on a case by case basis.
Water Metering	If it is not possible nor can an agreement be reached to meter the existing units, then a separate tapping may be required to service the new units or factoryettes with sub/check meters.

Figure 13.2: Additional Units or Factories to Existing Developments where Existing Unit Owners Do Not Wish to be Individually Metered

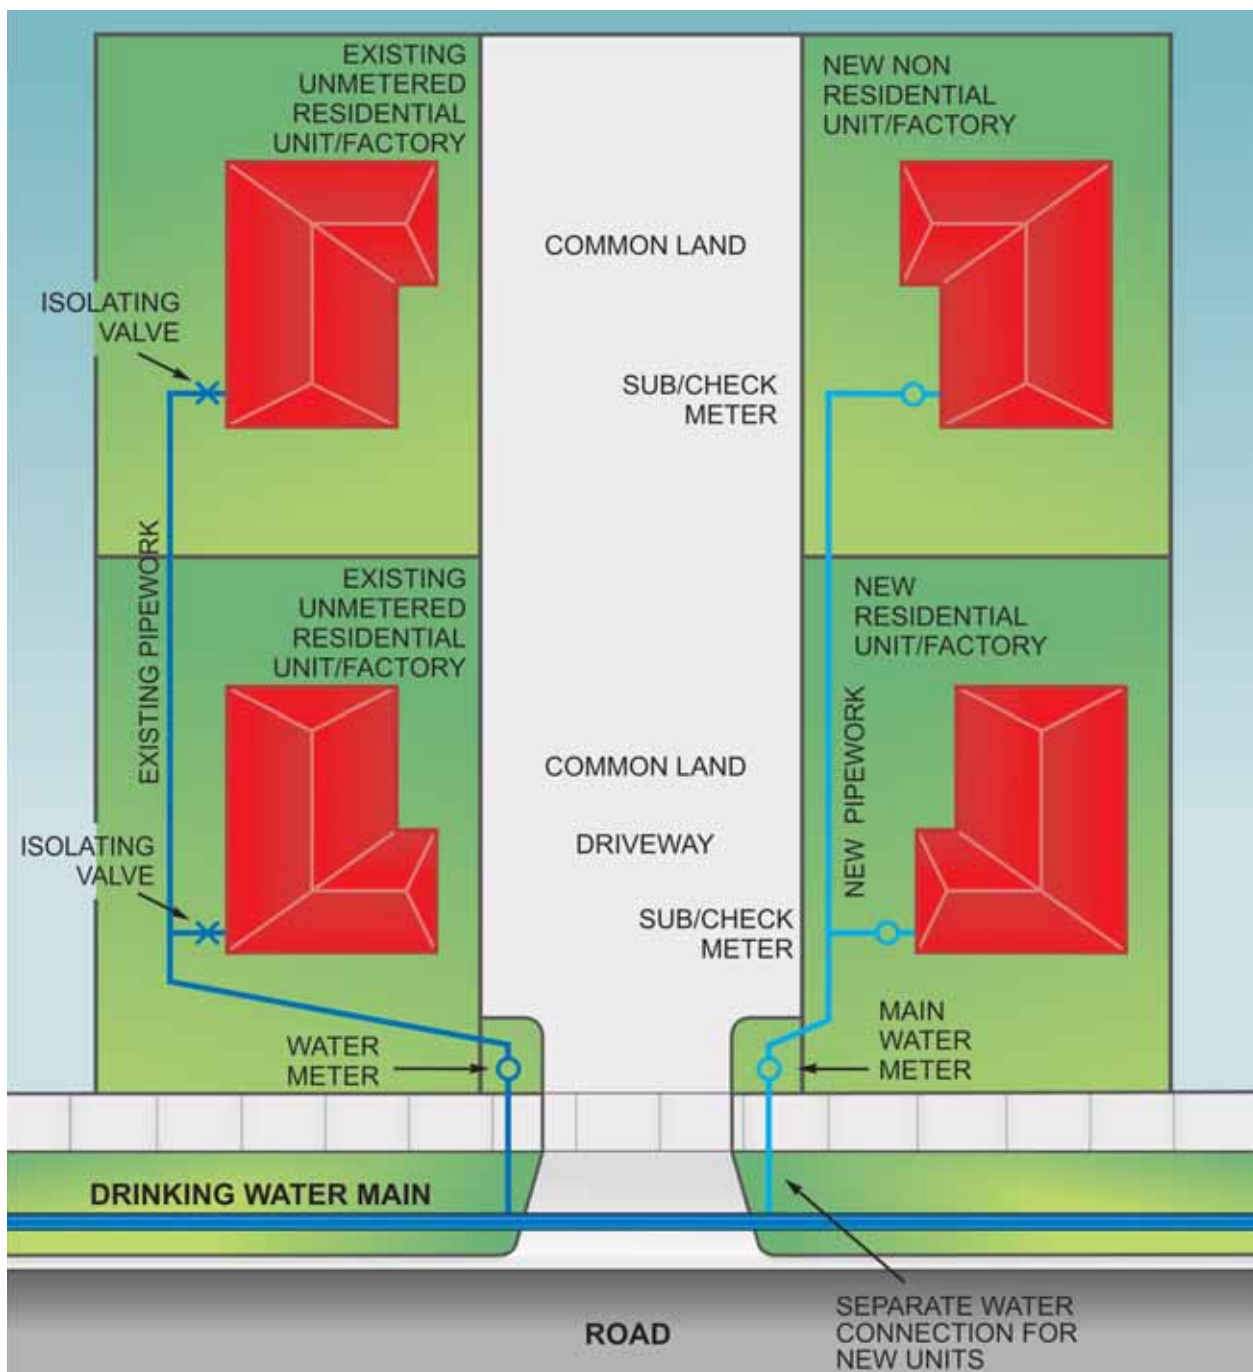

13.3 Existing Multi-Occupancy Residential and Non-Residential Developments with no existing Sub/Check Meters

Definition	In many existing developments (generally constructed prior to 1997) only a main water meter was provided with the water usage being divided among the occupants of the individual occupancies. In such cases some customers wish to install individual water meters to allow them to monitor their water usage.
Water Metering	<p>Existing dwellings/occupancies are permitted to be individually metered, however in the case where one occupancy owner requires a separate water meter but cannot reach agreement with the other owners to install sub/check water meters to all dwellings/occupancies, the following applies:</p> <ul style="list-style-type: none"> • A letter from the Owners Corporation authorising the installation of the water meter/s. The letter must also state that they are aware that any common water usage will be split over the dwellings/occupancies that remain unmetered. <p>or</p> <ul style="list-style-type: none"> • The signatures of all of the dwelling/occupancy owners consenting to the partial water metering of the development. A letter must state that they are aware that any common water usage will be split over the dwellings/occupancies that remain unmetered. <p>or see Servicing below</p>
Servicing	A separate tapping with a main water meter may be permitted to service the dwellings/occupancies, however it must be demonstrated that common water usage is not provided as part of the plumbing installation.


13.4 Properties Serviced by Temporary Private Water Service

Definition A Private Water Service is installed by the owner's contractor at the owner's cost where a reticulated water main is not required to be extended to service:

- Houses
- Farms
- Factories

Note: Private water services are temporary and may be disconnected by the Relevant Water Business at its discretion. Private water services must be removed from service where a reticulated water supply main is installed in the future. All costs are to be borne by the property owners.

Figure 13.3: Private Water Main Remote from Reticulation Supply

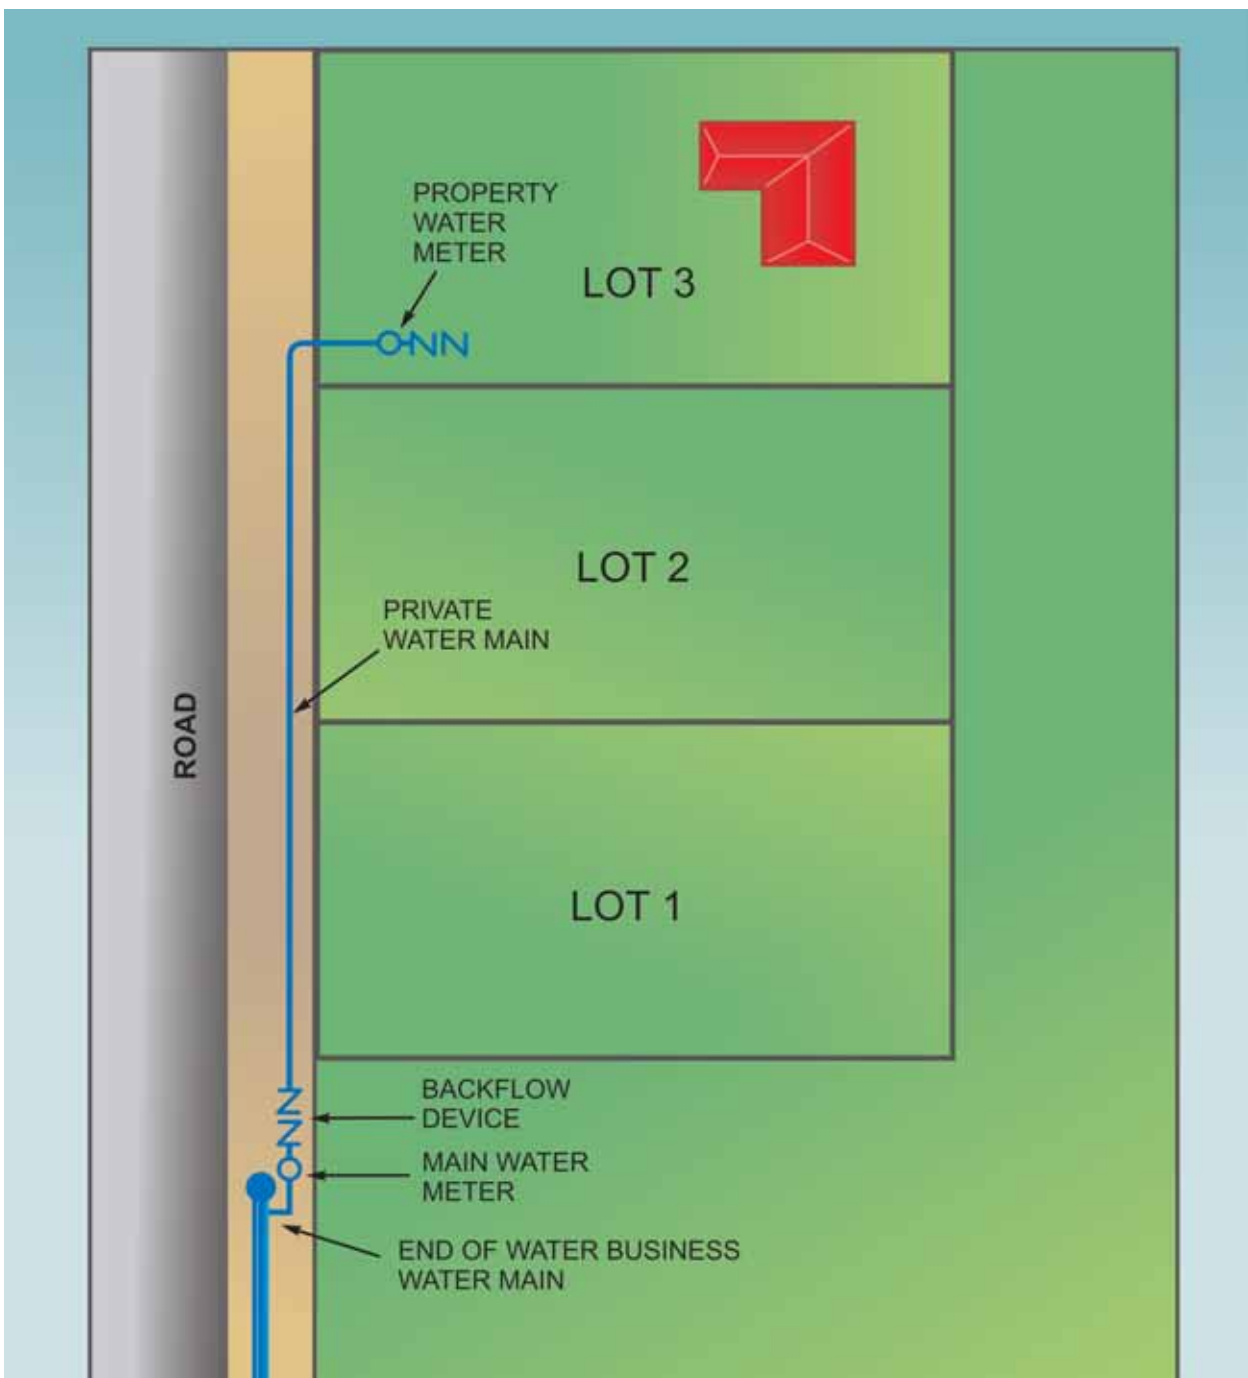

Water Metering

- All new private water services must be metered by a private water service main water meter at a point as close as practicable to the connection at the reticulated water main.
- The water meter must be located in a position that prevents damage and provides ease of reading and maintenance within a lockable cage fitted over the water meter assembly to prevent tampering.
- Each individual tapping point off the private service must be metered.
- For each property connected a water meter is required on the drinking water supply, at the property boundary.

Servicing

- Private water services will only be permitted in cases where the Relevant Water Business determines that a property is too remote from existing reticulated water infrastructure. This will be assessed having regard to potential future development and the distance from existing infrastructure.
- Application must be from a single legal entity.
- A design plan of the proposed private water service is required to be submitted to the relevant Water Business for approval prior to commencement of works.
- Details are to be provided to the relevant Water Business regarding Council/other authorities approval in relation to the following:
 - Location and depth of the proposed service.
 - Relevant environmental/cultural assessment has been carried out.
 - Pipe material must be approved (such as Polyethylene, MPVC, OPVC) and PN12.5 as a minimum, and must be WaterMark approved.
 - All plumbing to be in accordance with Plumbing Regulations incorporating the Plumbing Code of Australia.
 - Isolation valves are to be installed at 300m maximum intervals along the length of the private water service. All valves are to be fitted with risers, valve covers and concrete surrounds at surface level.
 - The owner is required to contact the relevant Water Business to arrange for the work to be verified prior to final backfilling of trenches. A 1000 kPa minimum pressure test is to be carried out on the pipeline in the presence of a Water Business representative. This may have to be increased depending on the maximum working pressure of the private service.
 - The alignment of the as-constructed private water service is to be surveyed on completion and forwarded to the Relevant Water Business.
 - The owner must agree to indemnify the Relevant Water Business from and against all claims for loss, damage, injury or whatsoever which may arise out of the installation, operation or use of the private water service.
 - All owner obligations shall transfer to Successors in title is S63 part 4A Water Industry Act.
 - All property water meters on the nominated private water service will be totaled at the quarterly water meter readings and checked against the Water Business billing water meter at the tapping connection. Any significant variation between the total of the property water meters and the billing water meter will be divided equally between the property owners of the private water main.
- The service is provided with no guarantee of quality, pressure, flow and continuity of supply.
- Private water services are not intended to be provided for fire fighting purposes.

13.5 Bulk Water/Common Water

Definition	On Owners Corporation developments which are individually metered and have bulk water supplied for hot water purposes, swimming pools and other common uses, the amount of water supplied for these purposes will be billed to the Owners Corporation.
Water Metering	Bulk water usage will be determined to be the balance of water supplied between the sub/check meters and the main water meter. Bulk Water usage will be billed to the Owners Corporation.

13.6 Trade Waste

Definition	Trade waste is the discharge from premises as a result of trade, industrial, medical, dental and commercial premises. These premises require discharging trade waste to comply with the terms and conditions set out in the Trade Waste Agreement.
Water Metering	Flow metering of trade waste effluent is required if requested by the individual Water Businesses. Water metering is required to monitor water usage associated with trade waste discharge, in accordance with these requirements.
General Requirements	<p>Trade waste flow meters are owned, maintained and installed by the owner at the request of the relevant Water Business. It is the responsibility of the owner to ensure that the flow meter:</p> <ul style="list-style-type: none"> • Is installed, operated and maintained in good working order. • Continually records the rate of flow of trade waste. • Incorporates a totaliser, calibrated to record in kilolitres, which cannot be reset to zero. • Is capable of activating an automatic sampler. • Is calibrated annually by an accredited company. <p>The owner must also:</p> <ul style="list-style-type: none"> • Give the relevant Water Business a copy of each calibration certificate, within two weeks of receipt.
Additional References	See the Relevant Water Business trade waste policy.

13.7 Non-Residential Irrigation Systems/Council Open Space

Definition	Irrigation Systems typically found in Council reserves, nature strips, median strips and school reserves.
Water Metering	<p>Water metering is required of all irrigation systems</p> <p>Water meters are to be:</p> <ul style="list-style-type: none"> • Installed above ground in accordance with these Guidelines. • Protected from damage and have regard to all Occupational Health and Safety requirements for public areas. • For nature strips, as close as practicable and adjacent to the water main connection.
Servicing	<ul style="list-style-type: none"> • A single tapping is to be provided to service irrigation systems. • Upon application a second tapping will be considered where a dual supply arrangement is proposed and the services are to be interconnected. • Dual supply from water mains in different pressure supply zones will not be permitted. • The maximum size of the metered service is generally limited to 40mm diameter (2.10 Litres/sec). • Irrigation main line piping that traverses roadways shall be either copper or polyethylene pipe and fittings, minimum Class PN12.5. • Street reserve mainline piping must be laid providing a horizontal clearance of 600mm from a water or sewer asset. • Any new Class A recycled water system piping, pipe sleeves, identification tapes outlets and sprinkler heads shall be coloured purple in accordance with AS2700 and provided with signage 'warning recycled water do not drink' in accordance with AS1345. • Irrigation systems must be fitted with an approved master solenoid valve to ensure that main lines up to individual sprinkler station solenoid valves are not under constant pressure. The master solenoid should be located close to the water meter assembly to reduce the length of pressurised irrigation piping. • Irrigation systems must incorporate moisture sensors to ensure watering is controlled during or following periods of rain. • Drinking water systems time of operation must comply with permanent water restriction requirements. The time of operation of Class A recycled water systems is restricted to the hours of 10.00pm to 10.00am. • Where the irrigation system is not of a temporary nature, the water service pipes shall not exceed 30 metres in length between the water main and the water meter. A water main extension will be required where this cannot be achieved. <p>General Conditions</p> <ul style="list-style-type: none"> • Plumbing work must be installed by a licensed plumber in accordance with the Victorian Plumbing Regulations incorporating the Plumbing Code of Australia. • The design and sizing of the metered service will be the responsibility of the applicant. • All work must be maintained in accordance with the Water Business' Customer Charter. • The drinking water service and Class A recycled water service installations shall comply with Australian Standard AS/NZS 3500.1:2003 Water Services. <p>Note: The workmanship, valves, fittings and all materials on the upstream side of, and including the last pressurised valve on the line, shall meet this Standard. Class A recycled water property service pipes and water meter assembly requirements must comply with relevant sections of this guide.</p>

Recycled Water (where available) Environmental Requirements

- Development of an Environmental Improvement Plan.
- Customers will need to prepare an Environmental Improvement Plan (EIP) in accordance with the requirements of the current EPA Guidelines for Environmental Management - Use of Reclaimed Water (2003).
- The Guidelines set out management requirements to ensure long-term sustainable use of recycled water without risk to the environment and also human and animal health. The relevant Water Business will provide an EIP Template and assist the customer in preparing the EIP for their site. The EIP must be prepared and submitted prior to commencing construction of the irrigation system. If the customer fails to prepare or comply with an EIP, the Relevant Water Business will not permit the flow of recycled water or may suspend the supply of recycled water.
- For single residential properties generally a low hazard rated Dual Check Valve is required to be installed at the outlet of the water meter.
- Please note for properties within Yarra Valley Water's operating area a dual check water meter is used. This will not permit the flow of recycled water or may suspend the supply of recycled water.

Some of the key EIP requirements are given below:

Irrigation Practice

- Many different application methods can be used for irrigation with recycled water (sub-surface drip irrigation, above ground drippers, above ground spray systems). The system needs to be stated in the EIP.
- Watering should occur over night between the hours of 10.00pm and 10.00am.
- Run-off from the site is to be prevented due to the nutrients in the recycled water, particularly if it will flow into the stormwater system. This must be considered during the design of the system.

Nutrient and Salinity Budget

- The addition of nutrients to the soil through recycled water must be considered when undertaking fertiliser application. Additionally, the salt content of the recycled water may need to be considered when choosing plants.
- The customer will be required to undertake soil sampling prior to using recycled water and have the location identified on the areas EIP, monitoring to be carried out approximately every two-three years.

Managing Occupational Health and Safety (OH&S)

- Staff/contractor must be consulted to clearly identify OH&S roles and responsibilities.
- Staff/contractor inductions and refresher training shall also be provided, addressing the necessary knowledge and hazards about working with recycled water.

Contingency Plans

- Contingency Plans will need to be developed to manage any unlikely recycled water incidents such as pipeline bursts or runoff.

Auditing

- Water Business' may audit the site to check that recycled water is being used in accordance with the EIP.

Additional References

See Metropolitan Water Business 'Water Service Assembly Arrangements'.

13.8 Water Connections for properties having Drinking Water/Class A recycled water (other than single residential dry tapped properties)

Definition	<ul style="list-style-type: none"> • House • Terrace House • Strata unit • Irrigation Systems • Non Residential Properties
Water Metering	<ul style="list-style-type: none"> • A main water meter is required on the drinking water supply and also on the recycled water supply where available. • Both the Class A recycled water and drinking water property service pipes are to be installed at the same time with both tappings to be carried out concurrently. • Water meters must be readily accessible for reading, maintenance and replacement. Where the water meter is deemed to be inaccessible for reading, remote water meters will be required to be fitted (see section 8.2 - Remote Water Meters).
Drinking/ Recycled Water Requirements	<p>Drinking Water Wet Tapping Residential Properties:</p> <p>Drinking Water & Class A Recycled Water:</p> <ul style="list-style-type: none"> • The relevant Water Business will arrange to install the property service and connect it to the relevant Water Business water supply system/s. The owner/applicant must pay the relevant connection fee approved by the Essential Services Commission. • Both the drinking water and Class A recycled water meter assemblies will be positioned 300mm apart when viewed from the front of the property with the recycled water meter located on the left (refer Figure 6.2). • The recycled water meter inlet ball valve will be closed and fitted with a lock box by the relevant water business at the time of connection to the property. • The lock box is only to be removed by either water business staff, its contractor or the Plumbing Industry Commission for the purpose of conducting the commissioning inspection of internal recycled water plumbing. • A fee may be imposed for any unauthorised removal of this box.

**Drinking/
Recycled
Water
Requirements
(continued)****Class A Recycled Water Wet Tapping**

- The owner/applicant must arrange to install both the property service and the connecting works at the property owner's/applicant's cost. The property service pipe is to be solid jacketed purple polyethylene pipe (PN80 or 100 PE 12.5 minimum) and must be WaterMarked. PE pipe must not form any part of the water meter assembly.
- **In the case of short side installations** the service pipe is to be laid on the left of the drinking water property service pipe when viewed from the front of the property and maintain 300mm separation.
- **In the case of long side installations** the same conduit for the drinking water property service may be utilised, however the 300mm separation is to be maintained on both the upstream and downstream ends of the conduit.
- Water Business will install the connecting valve between the property service and the supply system. The owner/applicant must pay the relevant tapping fee approved by the Essential Services Commission.
- The owner/applicant must install the appropriate water meter, delivered by the Water Business contractor, while they are installing the connecting valve at the main.
- The recycled water meter inlet ball valve will be closed and fitted with a lock box or other locking device by the Water Business at the time of connection to the property.
- The lock box or locking device is only to be removed by either the Water Business, or its authorised agent for the purpose of conducting the commissioning 'Water Check' of internal Class A recycled water plumbing. Penalties apply for the unauthorised removal of the lock box.

Note: If at the time of connection the above works that the plumber is responsible for have not been completed, the tapping will be cancelled and a re-booking fee, as approved by the Essential Services Commission, will apply.

The owner/applicant must ensure that the installation of the connecting works for recycled water is in accordance with the Plumbing Industry Commission's Recycled Water Plumbing Guide for dual pipe plumbing systems, AS/NZS 3500 and Water Business requirements. 100% mandatory inspections of property service pipe and water meter assembly, up to the last pressurised valve, is required. Contact the relevant Water Business for advice.

**Drinking/
Recycled
Water
Requirements
(continued)**

Special conditions for installing recycled water supplies

- A purple Class A recycled water 5/8" inlet thread tap having a removable handle and sign reading "Recycled Water. Do not drink" must be installed to service the rear external area of the property.
- The recycled water meter inlet ball valve will be closed and fitted with a lock box by the relevant water business at the time of connection to the property.
- The lock box is only to be removed by either water business staff, its contractor or the Plumbing Industry Commission for the purpose of conducting the commissioning inspection of internal recycled water plumbing.
- The water meter assembly pipe work and fittings must be of an approved type, WaterMark approved and must be of an approved colour (purple).
- All pipes and fittings must never be painted any other colour.

Note: Where the pressure testing of pipework installed for the provision of Class A recycled water requires a temporary interconnection with the drinking water supply plumbing, such interconnection is to be removed prior to the commissioning inspection. The temporary interconnection is to be installed above ground at or near the water meter assembly.

Inspection of Work (Residential)

The owner/applicant must ensure that the installation of the connecting works for recycled water is inspected in accordance with Plumbing Industry Commission requirements and the water business 'Conditions of Connection', at the owner's/applicant's expense, at each of the following stages:

- **Stage 1** Main to water meter prior to back filling in the case of wet tapped properties only this inspection will be carried out by the Water Business approved contractor at the time of the tapping installation.
- **Stage 2** Water meter to building prior to back filling.
- **Stage 3** Rough-In.
- **Stage 4** Commissioning prior to the building being occupied and lodgement of a compliance certificate.

Use of Class A recycled water

The owner/applicant may only use Class A recycled water which we supply for the following purposes:

- Garden irrigation
- Toilet flushing
- Vehicle washing
- Washing down outdoor furniture and the exterior of buildings
- Filling or topping up ornamental water features and ponds that are not used for swimming.

For onsite fire services **excluding Fire Sprinkler Systems** the use of Class A recycled water for fire fighting purposes will be assessed on a case by case basis.

**Drinking/
Recycled
Water
Requirements
(continued)**

Drinking Water & Class A Recycled Water Non Residential Properties:

- The licensed plumber must arrange to install both the property service and the connecting works, at the owners' expense.
- The licensed plumber must expose the water main in accordance with the Water Business' requirements contained within this document .
- The relevant Water Business will install the connecting valve between the property service and our supply system. The owner/applicant must pay the relevant fee approved by the Essential Services Commission.
- Both the property service and the connecting works must be installed at the property owners' expense.
- The property service pipe must be solid jacketed polyethylene pipe (PE100 PN 12.5 as a minimum) and must be water marked. PE pipe must not form any part of the water meter assembly.
- **In the case of short side installations** the service pipe is to be laid on the left of the drinking water property service pipe when viewed from the front of the property and maintain 300mm separation.
- **In the case of long side installations** the same conduit for the drinking water property service may be utilised, however the 300mm separation is to be maintained on both the upstream and downstream ends of the conduit.
- The water meter/s must be installed prior to the connecting valve being installed by the water business tapping contractor. The water meter/s will be provided on site by the relevant water business tapping contractor.
- Refer to the approved water meter/pipework configuration/drawings for the installation of water service assemblies.
- If the work referred to above is not been completed at the time, and the relevant Water Business is to install the connecting valve, the owner/applicant will have to make a further booking. The owner/applicant must also pay any re-booking fee approved by the Essential Services Commission.
- If any existing drinking or recycled water service to the owner's/ applicant's property is to be disconnected, the owner/applicant must expose the existing property service connection at the drinking or recycled water main (as the case requires) at the owner's/applicant's cost, to allow us to disconnect and plug the existing property service. The owner/applicant must disconnect the relevant water meter and return it to the relevant water business or its contractor.

Note: The owner/applicant is required to obtain a Road Opening Permit from the relevant authority before commencing any excavation work within a road reserve. The owner/applicant must also comply with every traffic management requirement contained in that permit.

**Drinking/
Recycled
Water
Requirements
(continued)**

Special conditions for installing recycled water supplies

- Irrigation systems must comply with the relevant Water Business guide to the installation of irrigation systems. See relevant Water Business' web site for details.
- A purple Class A recycled water 5/8 inlet thread tap having a removable handle is required to service the rear external area of the property.
- A recycled water prohibition sign with the words "Recycled Water. Do Not Drink" and complying with AS1319 is to be installed above each recycled water tap outlet.
- The recycled water meter inlet ball valve will be closed and fitted with a lock box or locking device by the relevant water business at the time of connection to the property.
- The lock box or locking device is only to be removed by either water business staff, its contractor or the Plumbing Industry Commission for the purpose of conducting the commissioning inspection of internal recycled water plumbing.
- In the case where approval is given for the connection of a fire service to the Class A recycled water supply, the isolating valve at or near the property boundary will also be locked closed.
- Any pipe, tap or other fitting used or intended to be used to supply recycled water on the owner's/applicant's side of the recycled water meter must be of an approved type and colour in accordance with the 'Plumbing Industry Commissions Recycled Water Guide'.
- The water meter assembly pipework and fittings must be of an approved type, WaterMark approved and must be of an approved colour (purple)
- All pipes and fittings must never to be painted any other colour.

Educational & public buildings/areas - schools, kindergartens, health care centres

All external recycled water hose bib taps must conform with the requirements as previously detailed and in addition must either:

- Be fitted with a 'Hose Bib Tap Lock'.
- or
- Be installed in a secured location.

Other development types where hose bib taps require secured locations or tap locks to be determined on a case by case basis.

**Drinking/
Recycled
Water
Requirements
(continued)****Verification Inspection of Conditions of Connection for non residential properties**

The relevant Water Business will carry out an inspection of the recycled water plumbing work to verify its 'Conditions of Connection' have been complied with.

The installation of the connecting works for recycled water must be inspected in accordance with the water business 'Conditions of Connection', at the owners' expense, at each of the following stages:

- **Stage 1** Main to water meter prior to back filling.
- **Stage 2** Water meter to building prior to back filling.
- **Stage 3** Rough-In.
- **Stage 4** Commissioning prior to the building being occupied and lodgement of a compliance certificate.

Note: Where the pressure testing of pipework installed for the provision of Class A recycled water requires a temporary interconnection with the drinking water supply plumbing, such interconnection is to be removed prior to the commissioning inspection. The temporary interconnection is to be installed above ground at or near the water meter assembly.

Use of Class A Recycled Water

The owner/applicant may only use Class A recycled water which we supply for the following purposes:

- Garden irrigation
- Toilet flushing
- Vehicle washing
- Washing down outdoor furniture and the exterior of buildings
- Filling or topping up ornamental water features and ponds that are not used for swimming
- Onsite Fire services excluding Fire Sprinkler Systems (the use of Class A recycled water for fire fighting purposes will be assessed on a case by case basis).

Where rainwater is to be used for flushing of toilets via a rainwater tank, backup supply is only to be provided via an automatic change over device connected to the Class A recycled water supply.

**Drinking/
Recycled
Water
Requirements
(continued)**

Drinking Water/Class A Recycled Water Backflow Prevention Requirements

From the information provided, an initial assessment of the application will be made to determine the hazard level **for both the drinking water and Class A recycled water**.

In line with current regulations, Water Business' requires the owner/applicant to employ a suitably qualified person to check the business process on site to verify the anticipated level of hazard and install an appropriate containment device (WaterMark approved) located at the water meter, at or near the property boundary for the prevention of backflow.

When a testable backflow prevention device is to be installed, please complete the provided Backflow Prevention agreement form and return it to the respective Water Business to allow the device to be recorded on the Water Business register and enable the owner's water meter/tapping to be arranged.

In the interest of health and safety it is the responsibility of the property owner to ensure that containment, zone and individual backflow prevention is provided.

Verification Of Class A Recycled Water Internal Plumbing Systems

- The owner/applicant must ensure that the installation is verified in accordance with these requirements at the owner's/applicant's expense, at each of the following stages:
 - Main to water meter prior to back filling.
 - Water meter to master solenoid valve prior to back filling.
- Where the pressure testing of pipework installed for the provision of Class A recycled water requires a temporary interconnection with the drinking water supply plumbing, such interconnection is to be removed prior to the commissioning inspection.
- To arrange verification of the plumbing installation, please contact the relevant Water Business.

Environment Improvement Plan (EIP)

Prior to the supply of Class A recycled water being made available to the property, an approved Environmental Improvement Plan (EIP) is required to be submitted and executed by the Water Business.

14 DRAWINGS

Drawing number 1: 20-25mm general water service (wet tapping) – low hazard – residential/commercial/industrial – typical arrangement	57
Drawing number 2: 20-25mm general water service – medium hazard – residential/commercial/industrial – typical arrangement	58
Drawing number 3: 20-25mm general water service – high hazard – residential/commercial/industrial – typical arrangement	59
Drawing number 4: 32-50mm General water service – low hazard – residential/commercial/industrial – typical arrangement	60
Drawing number 5: 32-50mm general water service – medium/high hazard – residential/commercial/industrial – typical arrangement	61
Drawing number 6: 80mm+ general water service – low hazard – residential/commercial/industrial – typical arrangement	62
Drawing number 7: 80mm+ general water service – medium/high hazard – residential/commercial/industrial – typical arrangement	63
Drawing number 8: 32-55mm fire hose reel and general service – typical arrangement	64
Drawing number 9: 100mm fire hydrant/hose reel with detector checkvalve – typical arrangement	65
Drawing number 10: 80mm+ fire and general service combined – typical arrangement	66
Drawing number 11: 100mm Fire and general service – separated fire and general services after water meter – typical arrangement	67
Drawing number 12: Fire sprinkler & hydrant service – 80mm meter configuration – typical arrangement	68
Drawing number 13: 25-50mm fire sprinkler service & 20-50mm general service – typical arrangement	69
Drawing number 14: Booster connection around meter – fire sprinkler supply – typical arrangement	70
Drawing number 15: Booster connection around meter – fire hydrant supply – typical arrangement	71
Drawing number 16: Interconnected fire and general services – single water main supply from both directions – typical arrangement	72
Drawing number 17: Interconnected fire sprinkler/hydrant and general services – different Water mains connection – typical arrangement	73
Drawing number 18: Tapping configurations – typical arrangement	74

City West Water Ltd

247 - 251 St Albans Road
Sunshine Victoria 3020
Ph: 131 691
Email: enquiries@citywestwater.com.au
www.citywestwater.com.au

South East Water Ltd

20 Corporate Drive
Heatherton Victoria 3202
Ph: 131 694
Email: info@sewl.com.au
www.southeastwater.com.au

Yarra Valley Water Ltd

Lucknow Street
Mitcham Victoria 3132
Ph: 131 721
Email: enquiry@yvw.com.au
www.yvw.com.au

